




### SNP: A -> C Calibration

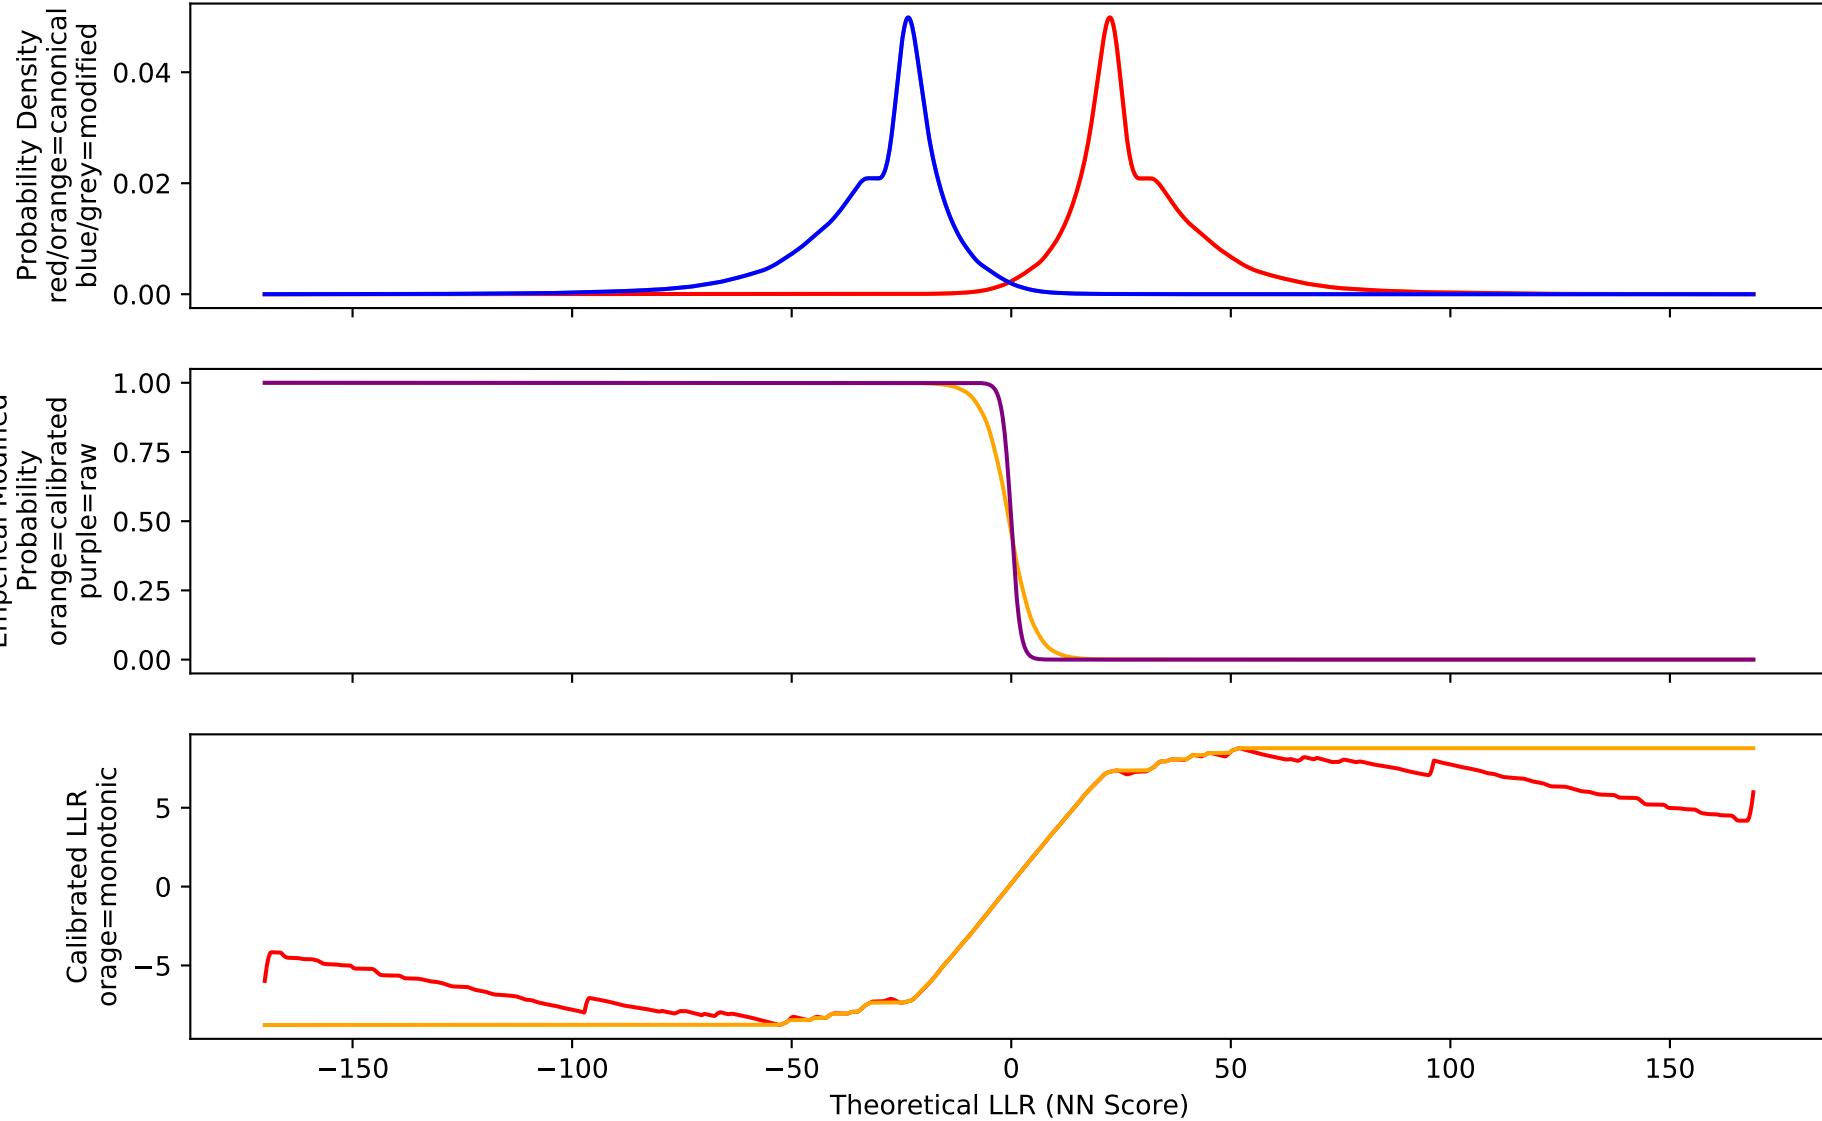


### SNP: A -> G Calibration

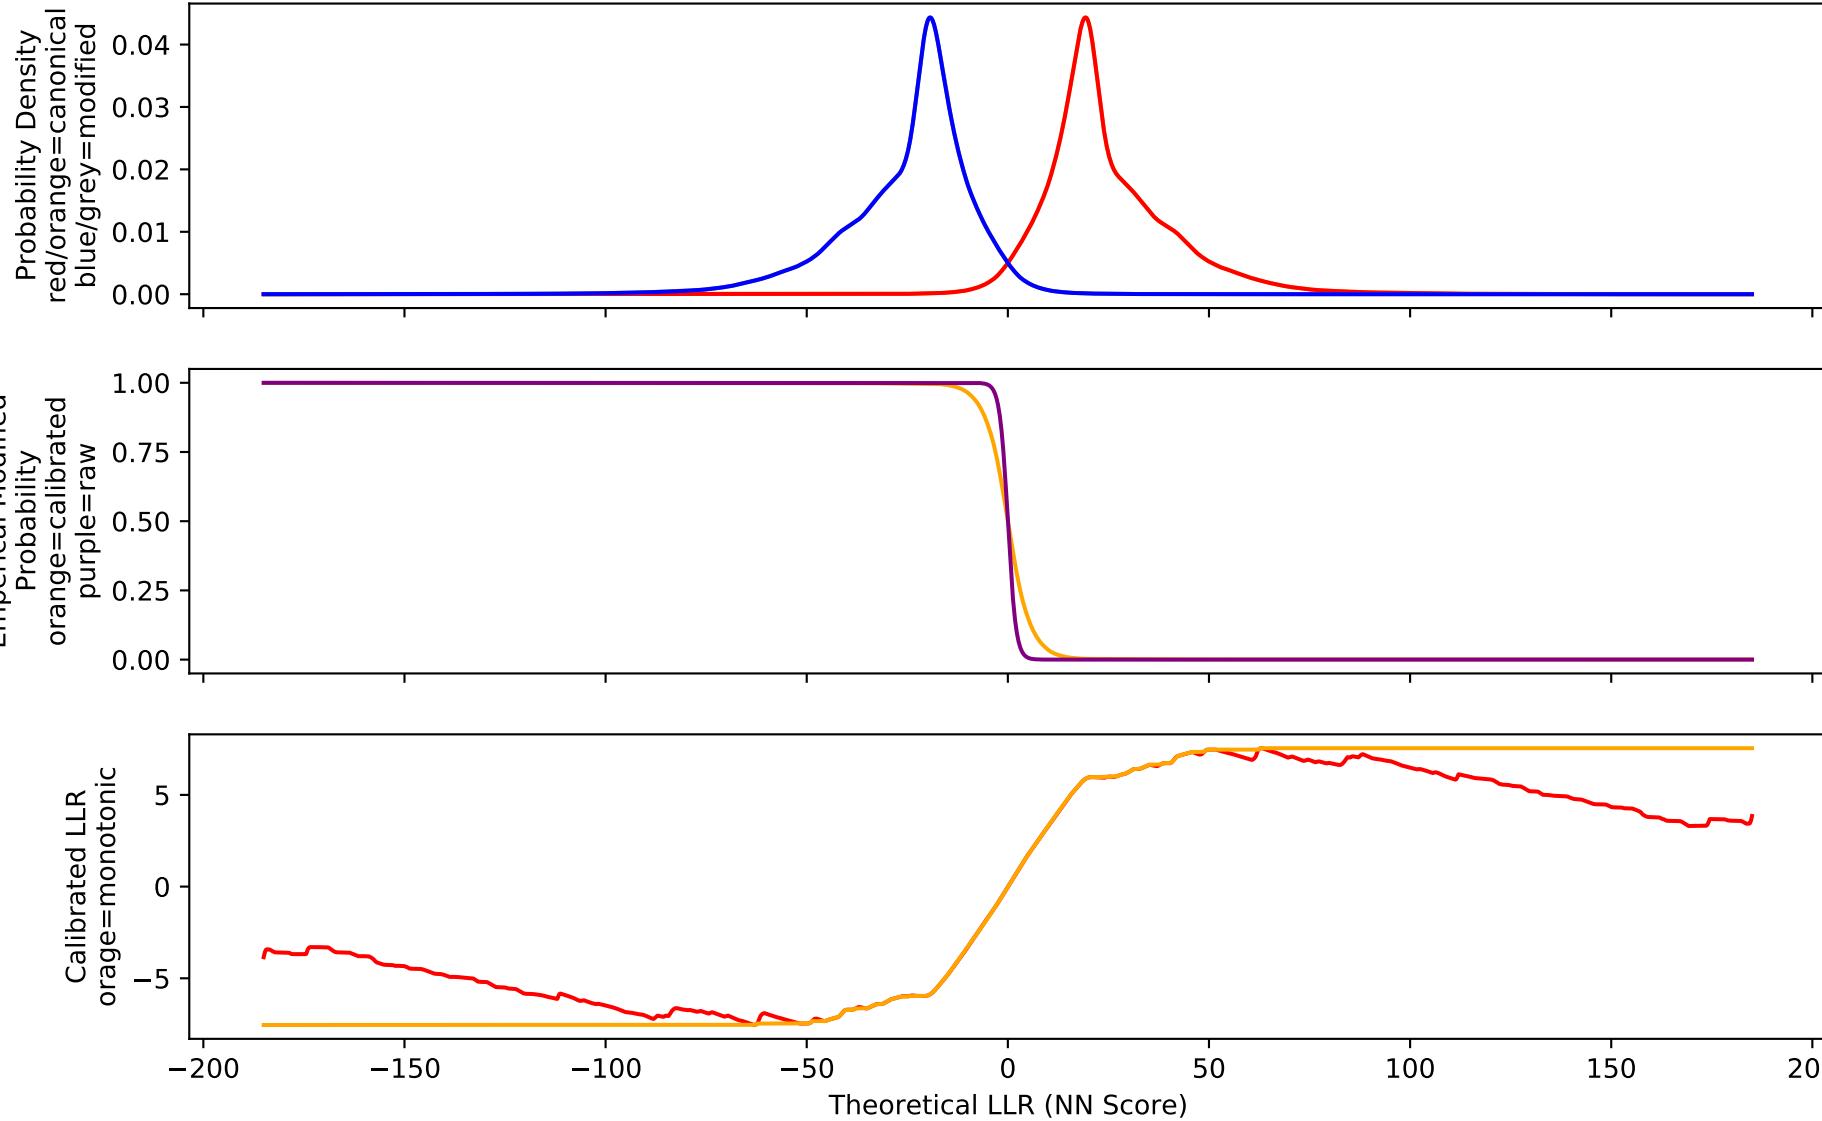


### SNP: A -> T Calibration

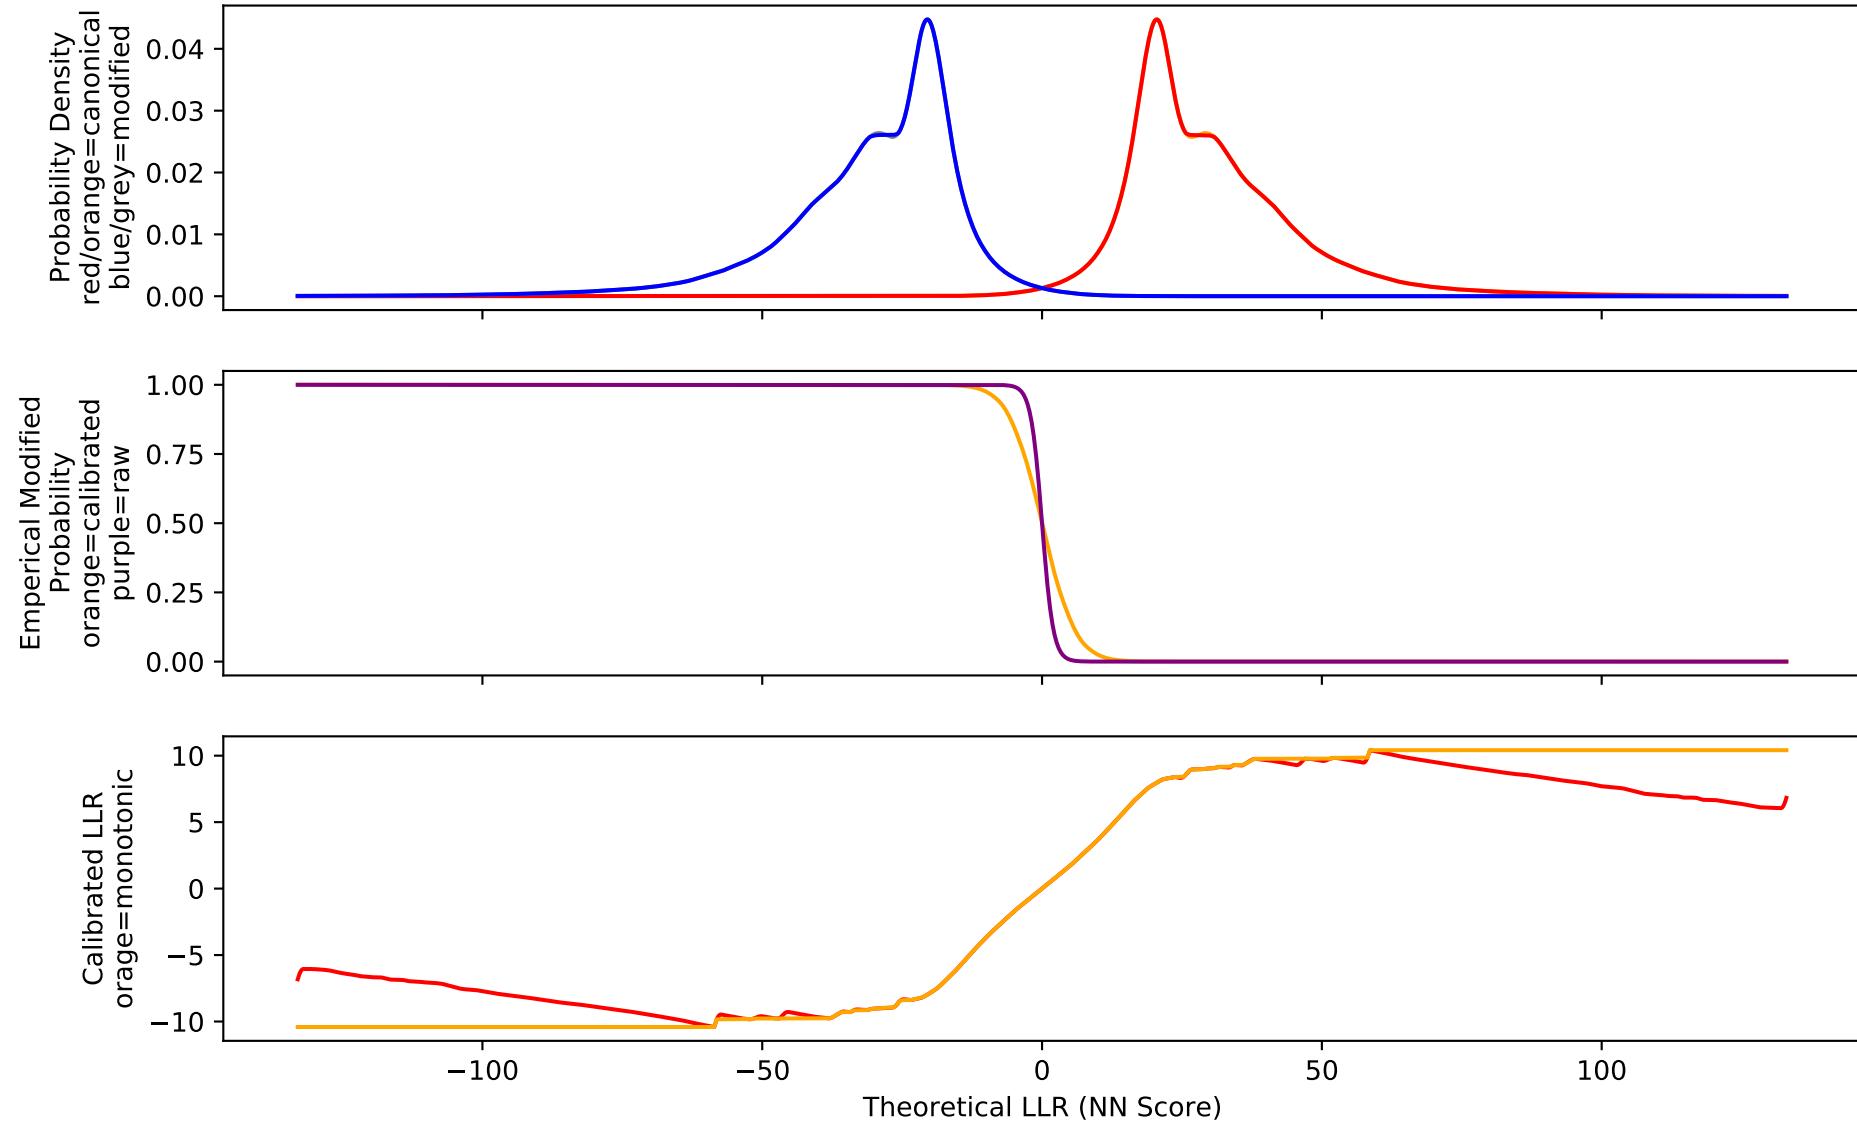


### SNP: C -> A Calibration

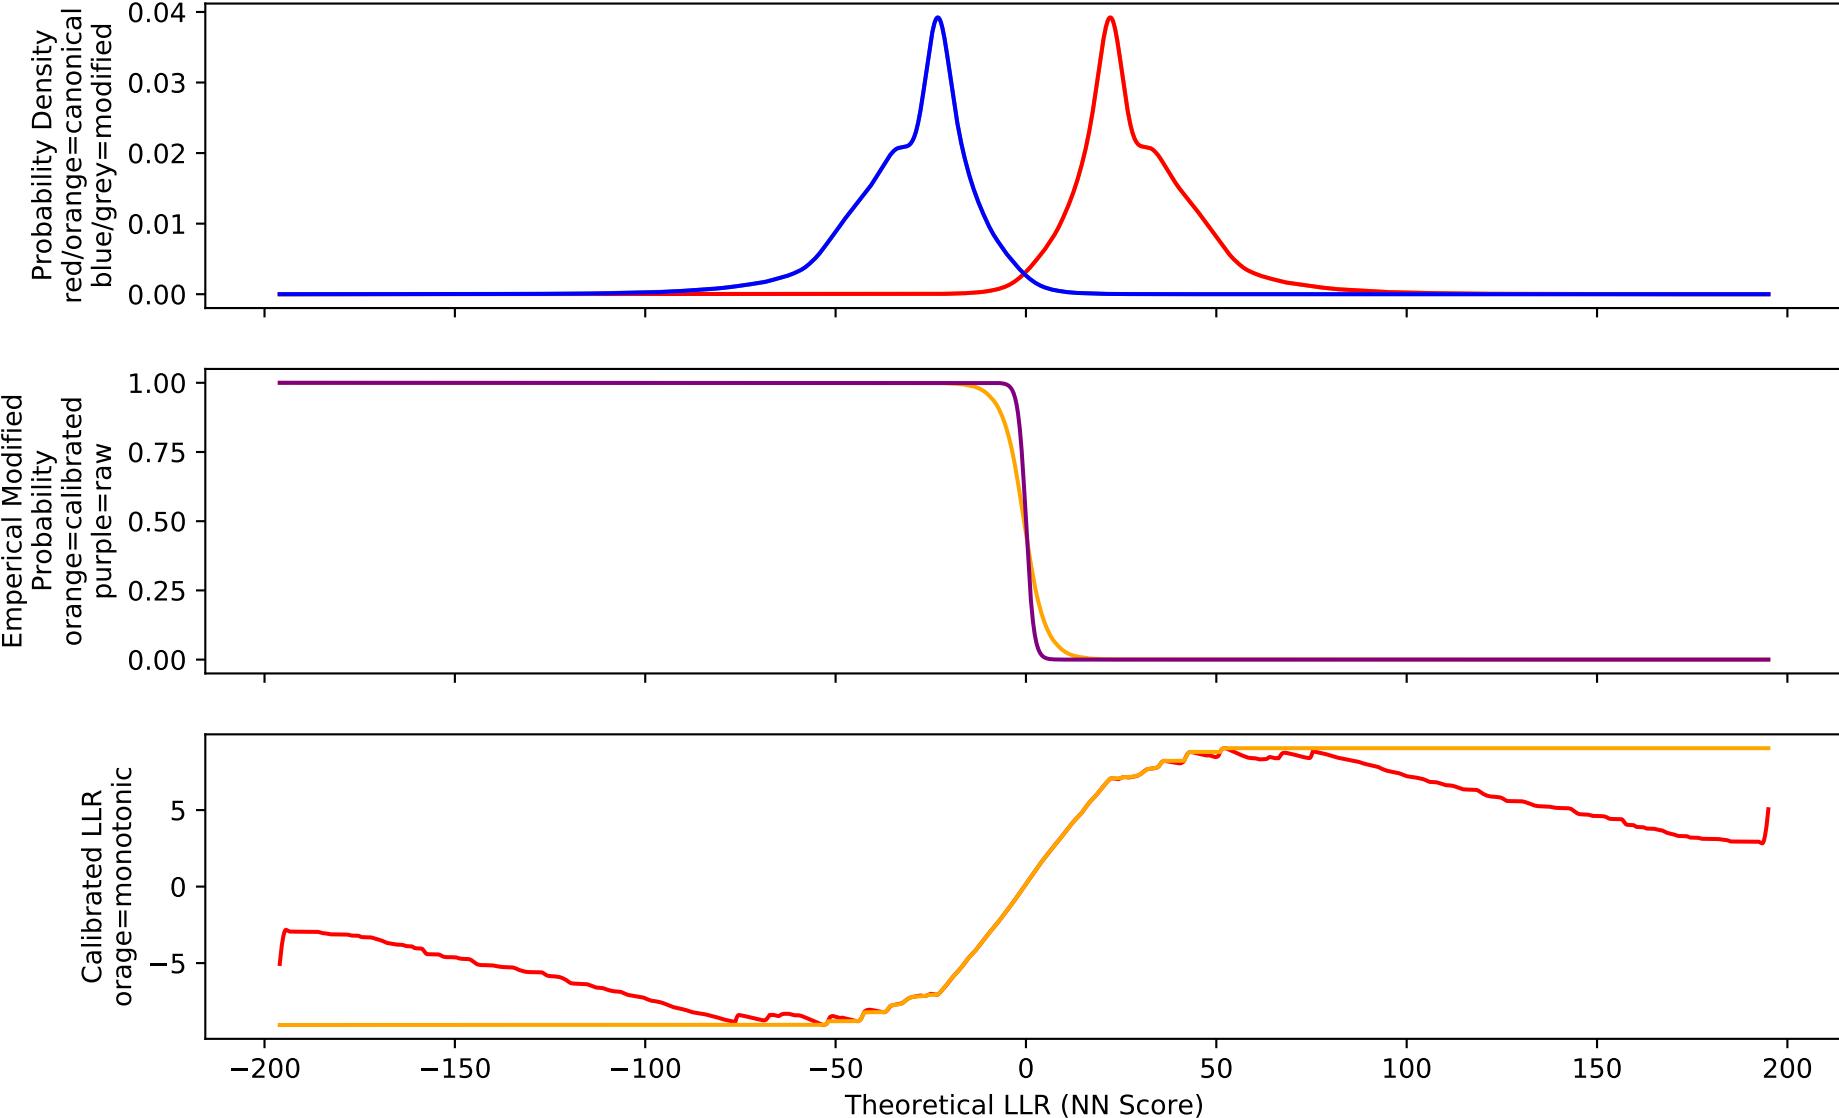


### SNP: C -> G Calibration

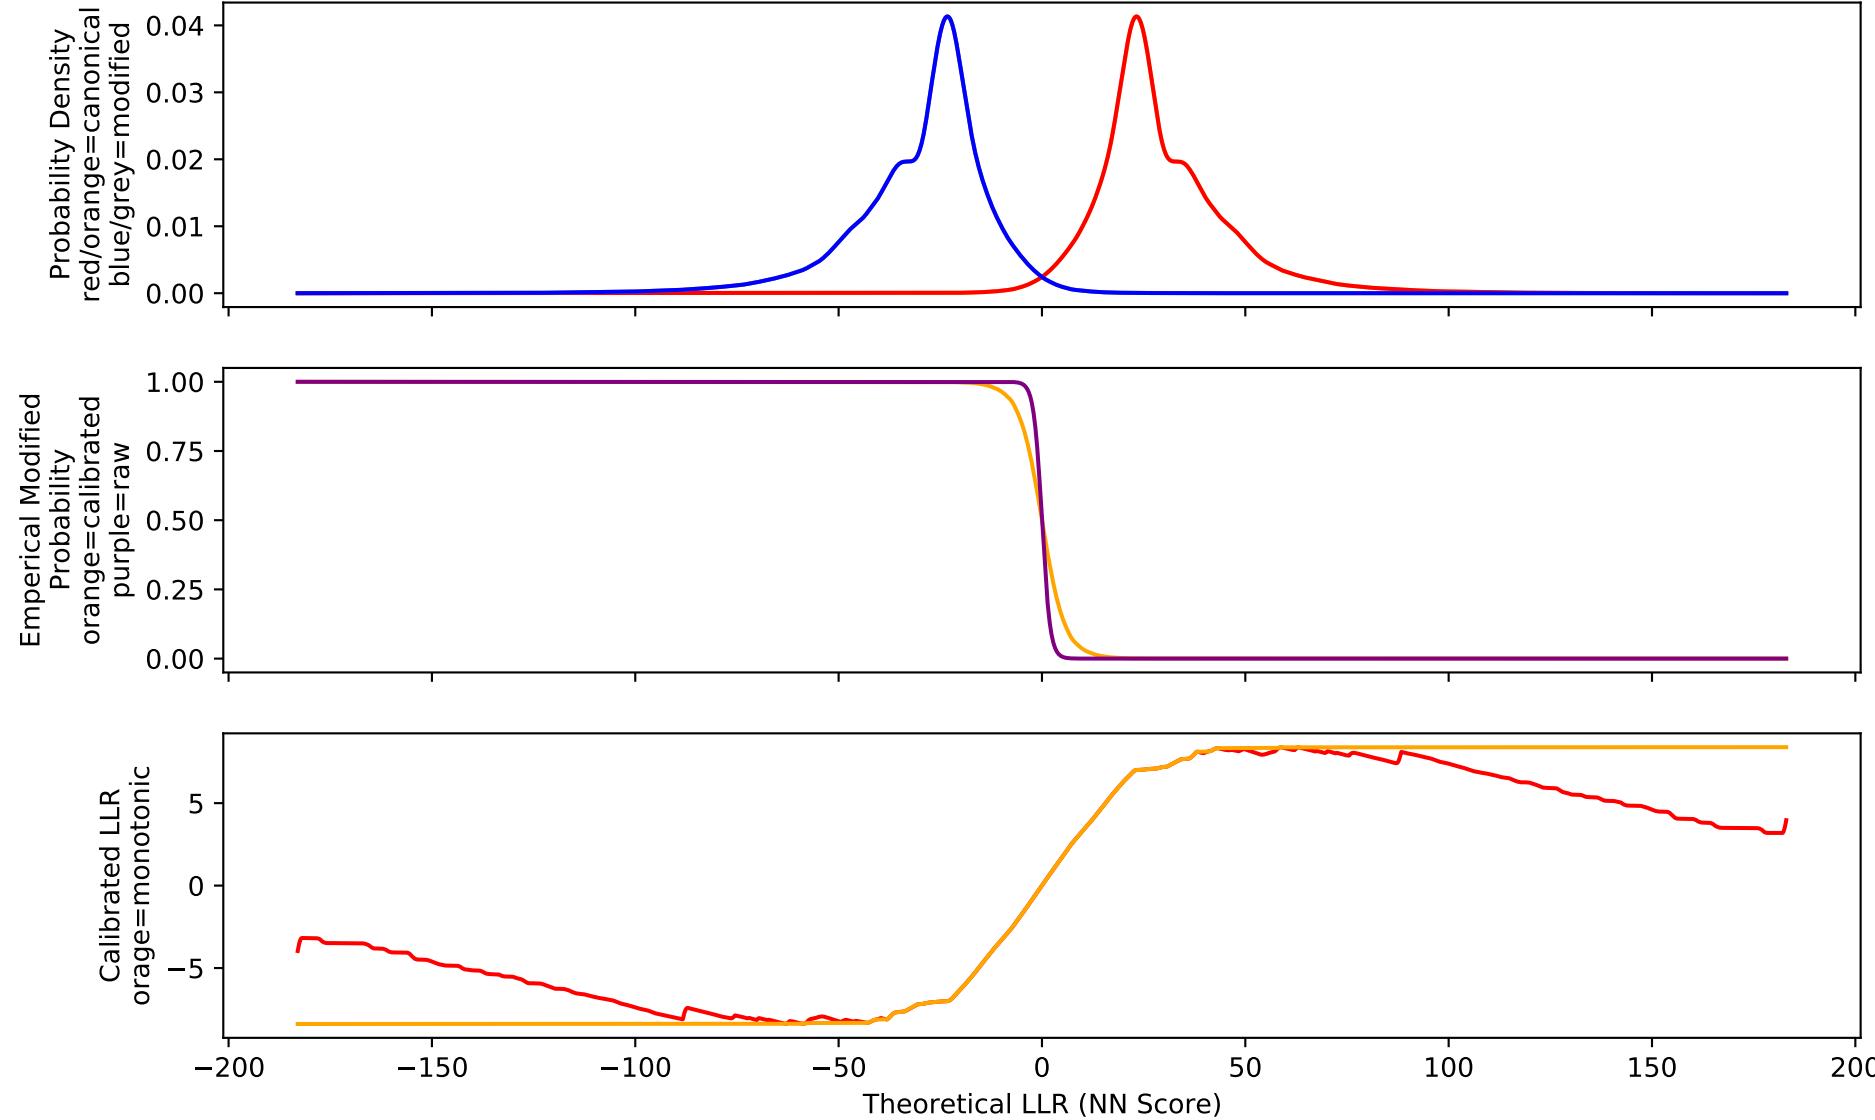


### SNP: C -> T Calibration

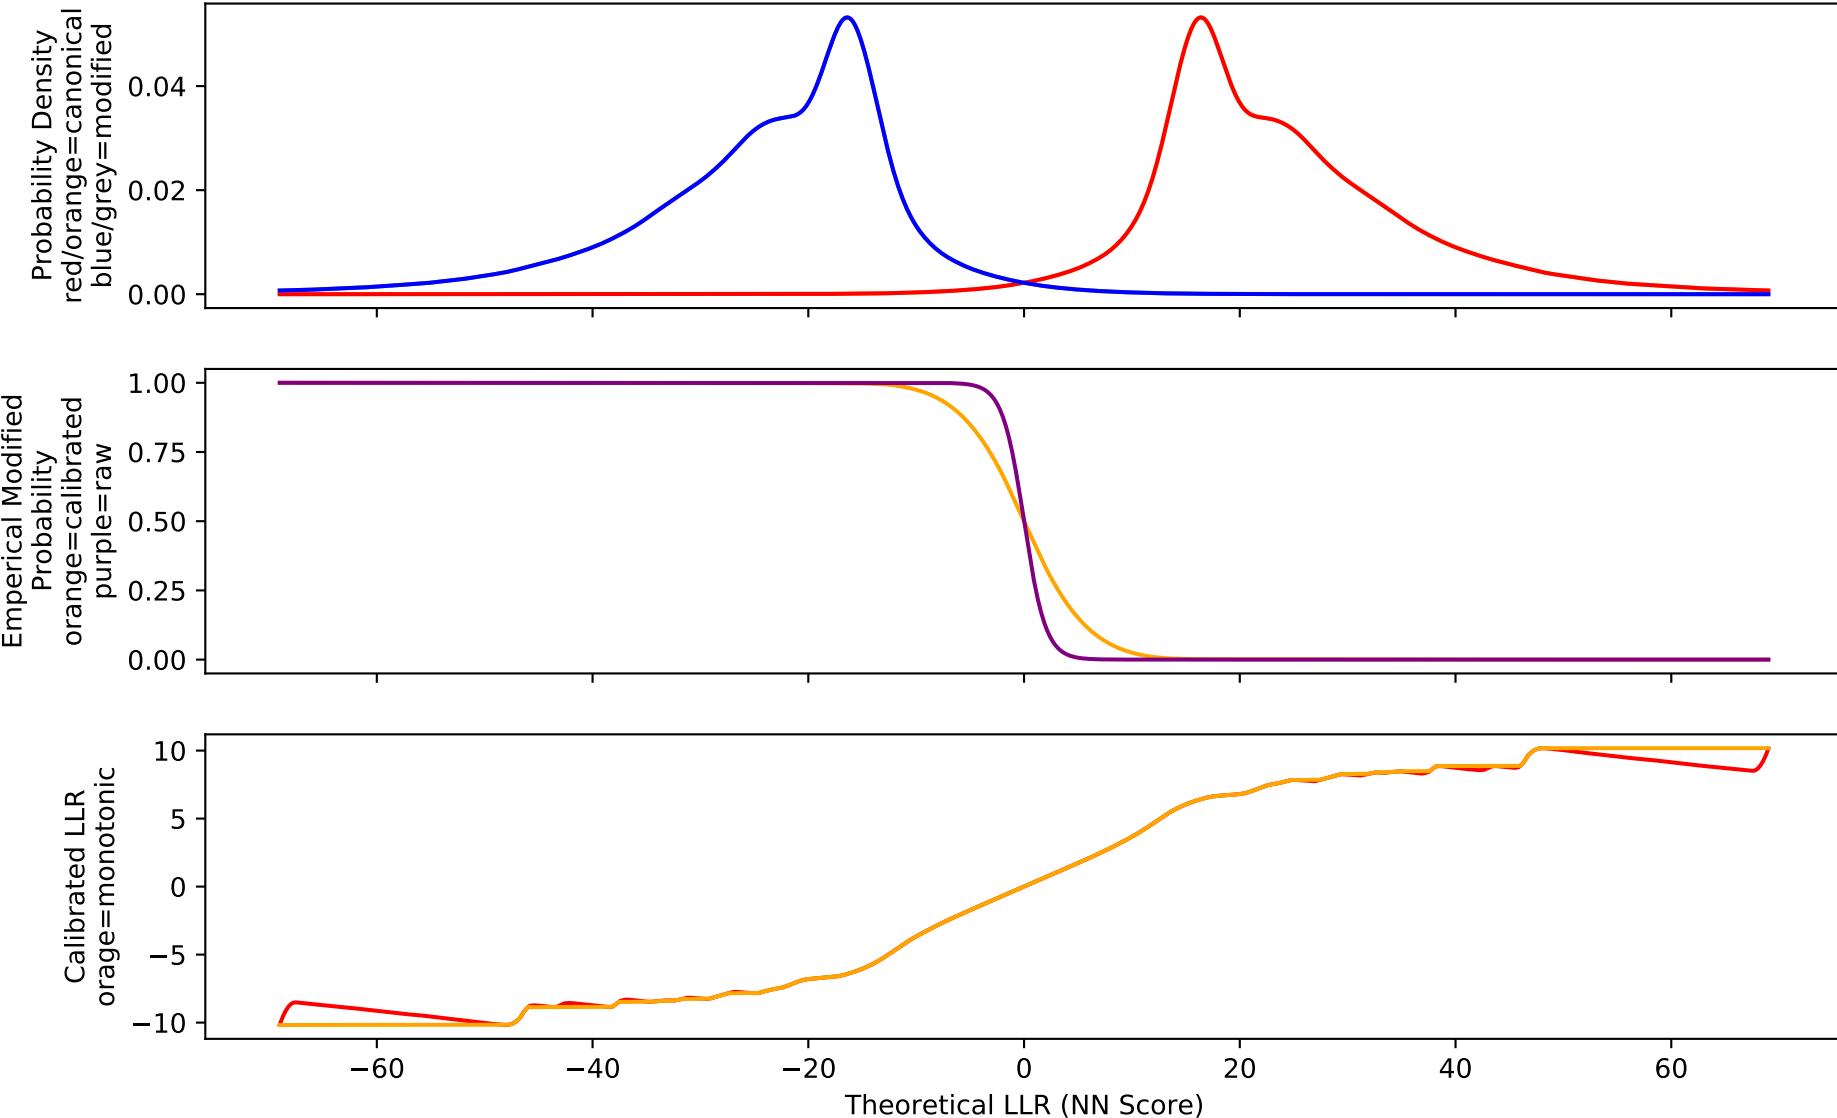


### SNP: G -> A Calibration

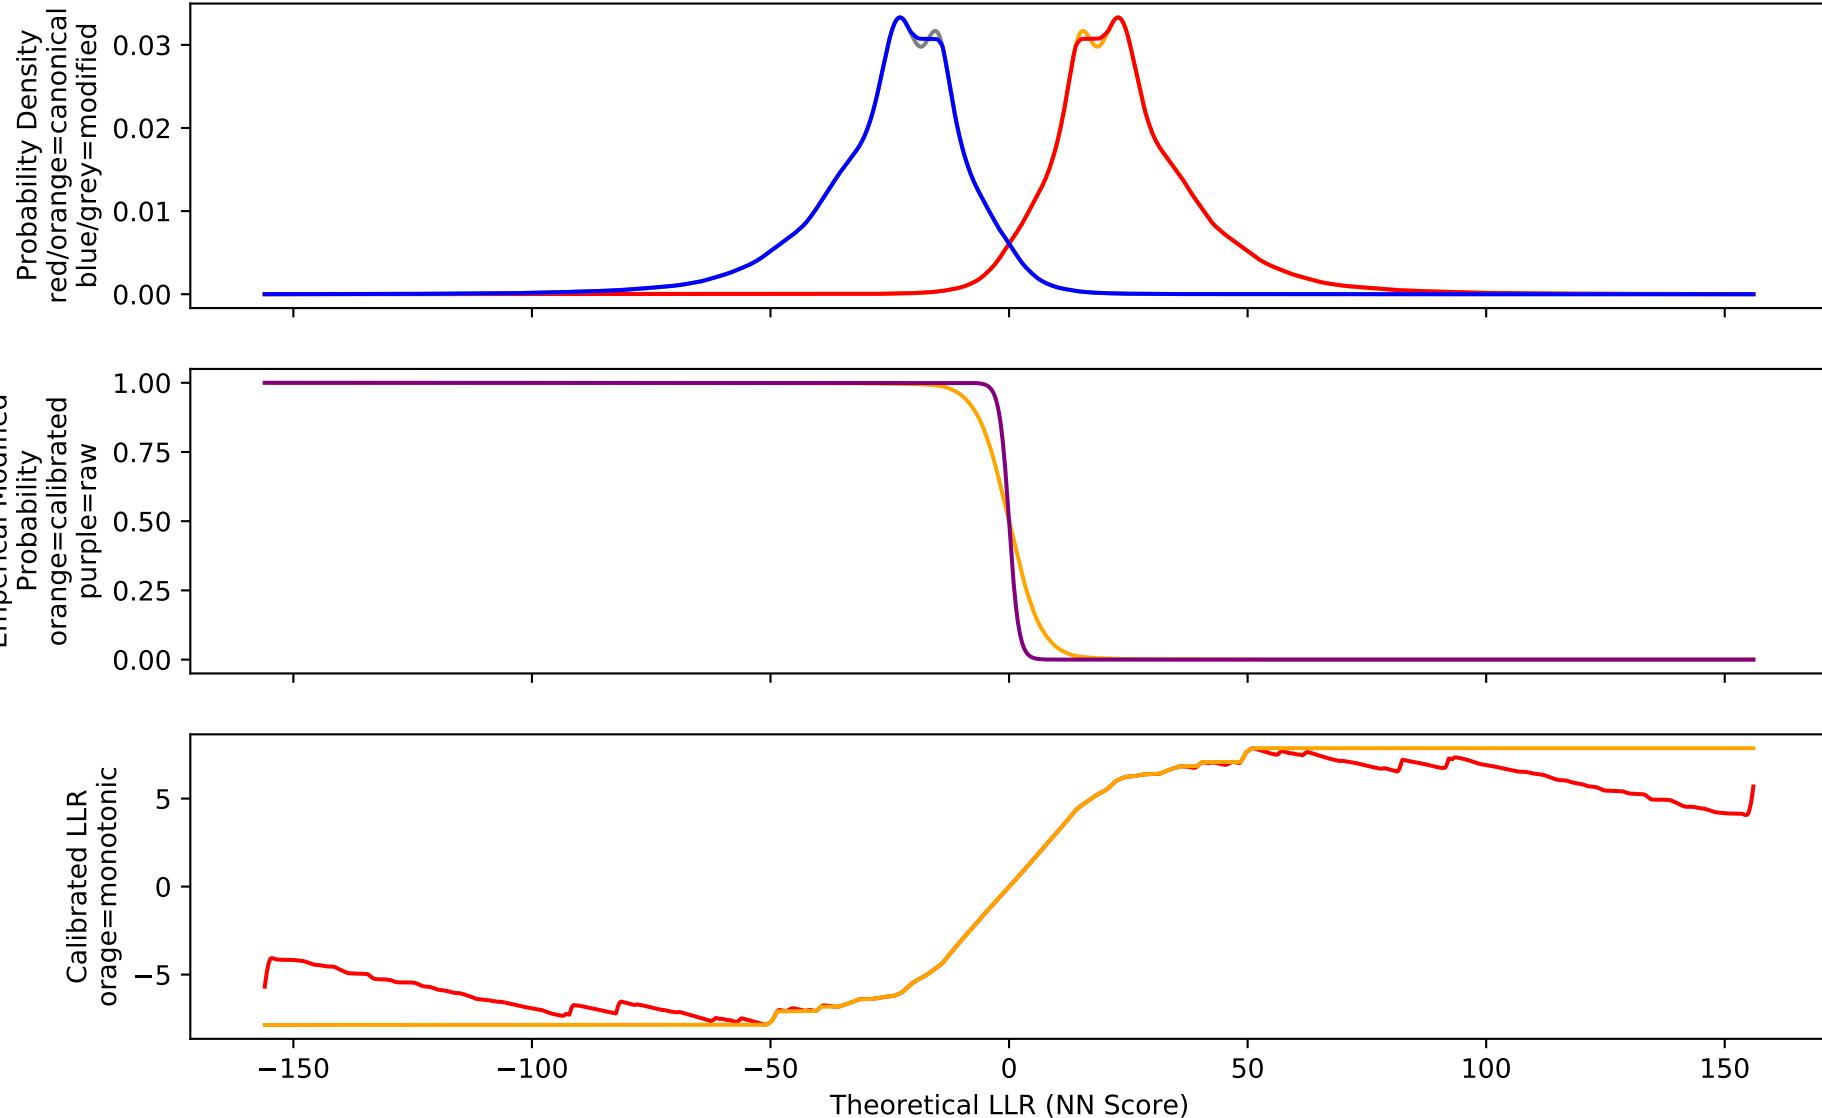


### SNP: G -> C Calibration

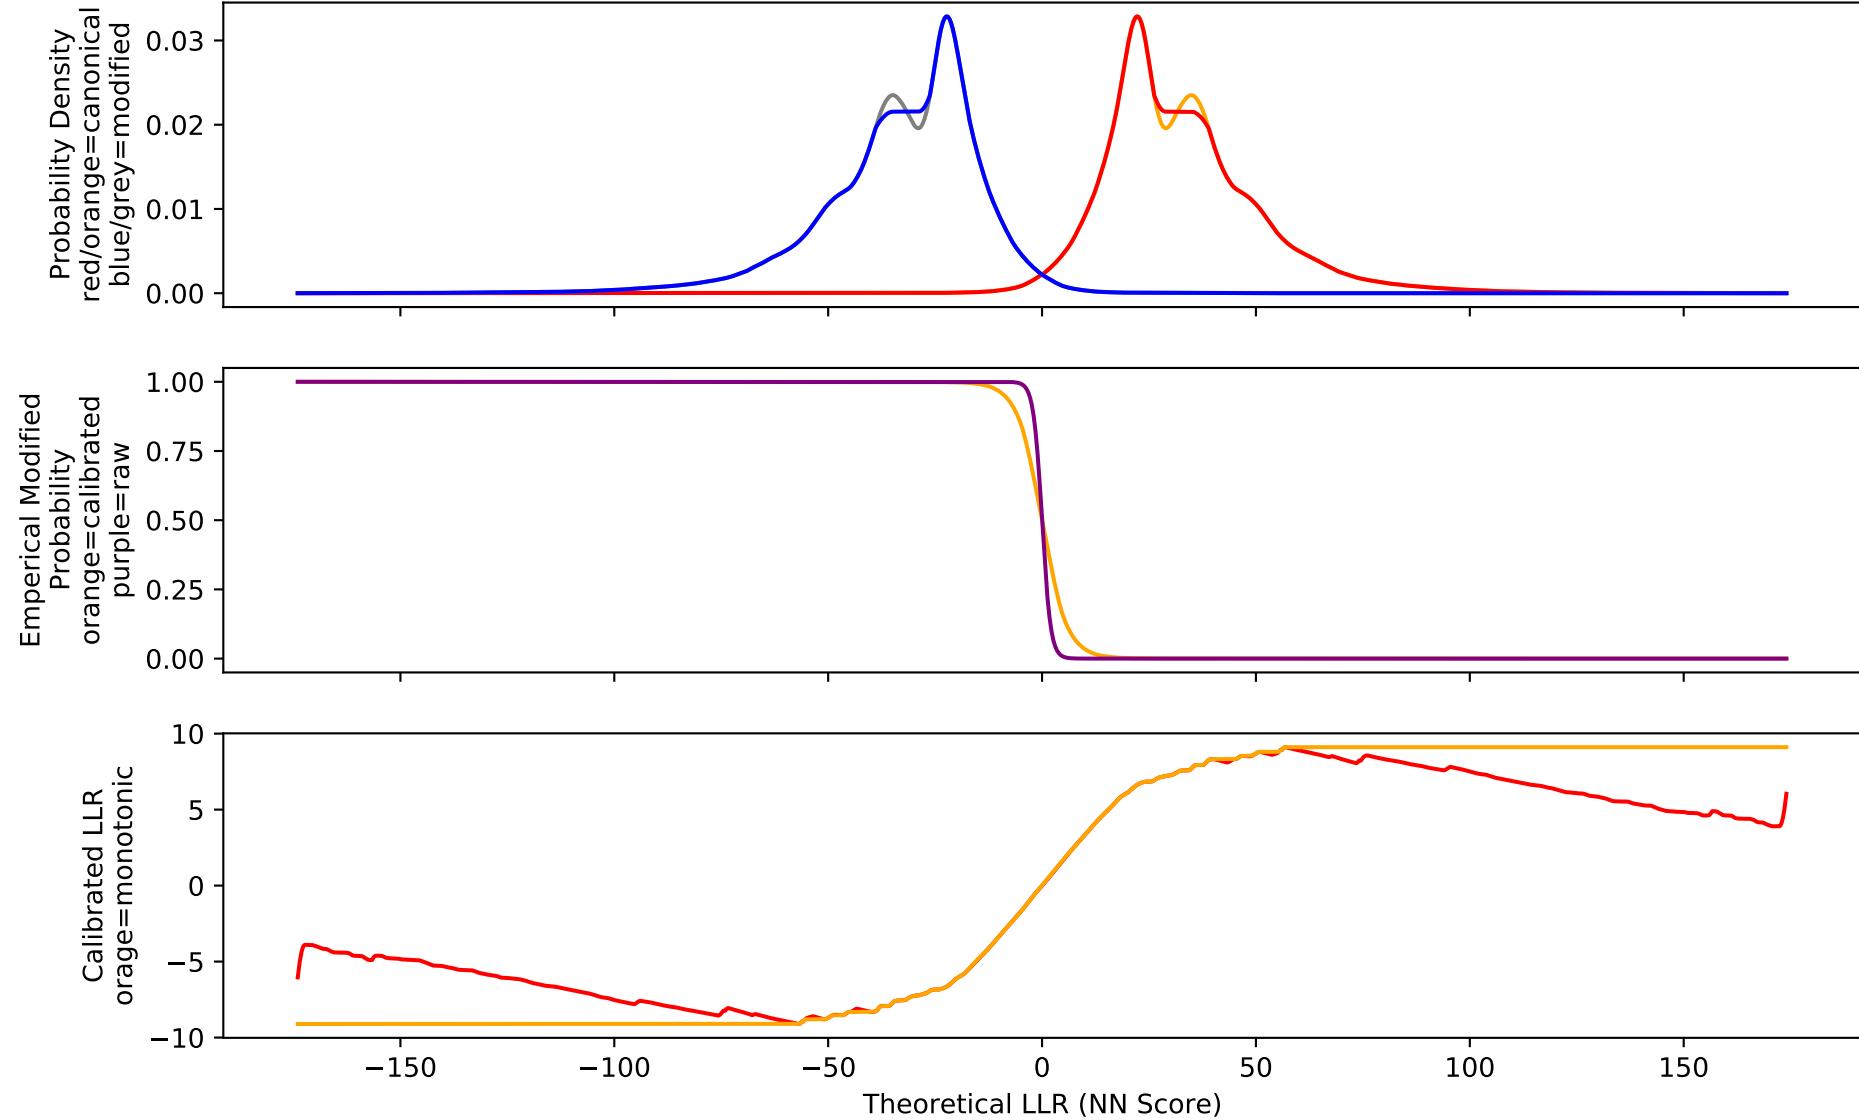


### SNP: G -> T Calibration

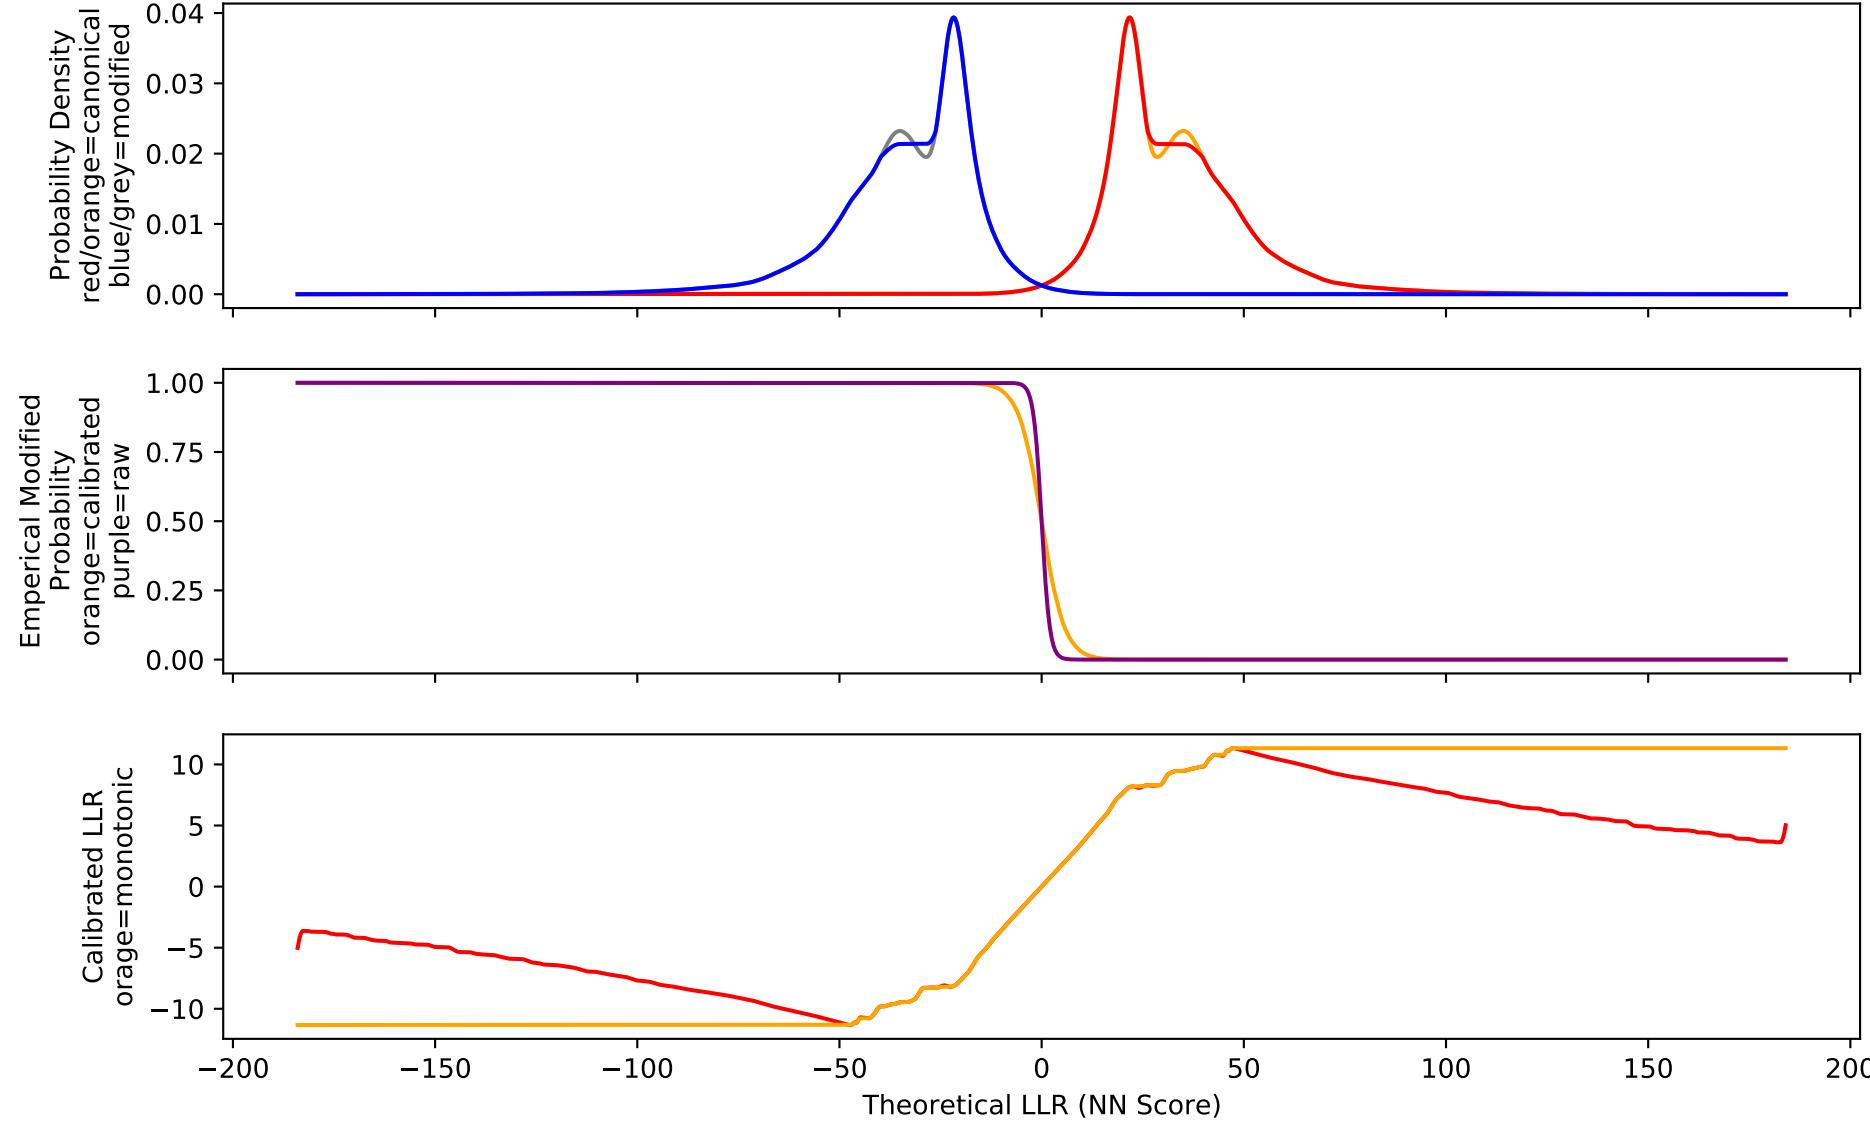


### SNP: N -> N Calibration

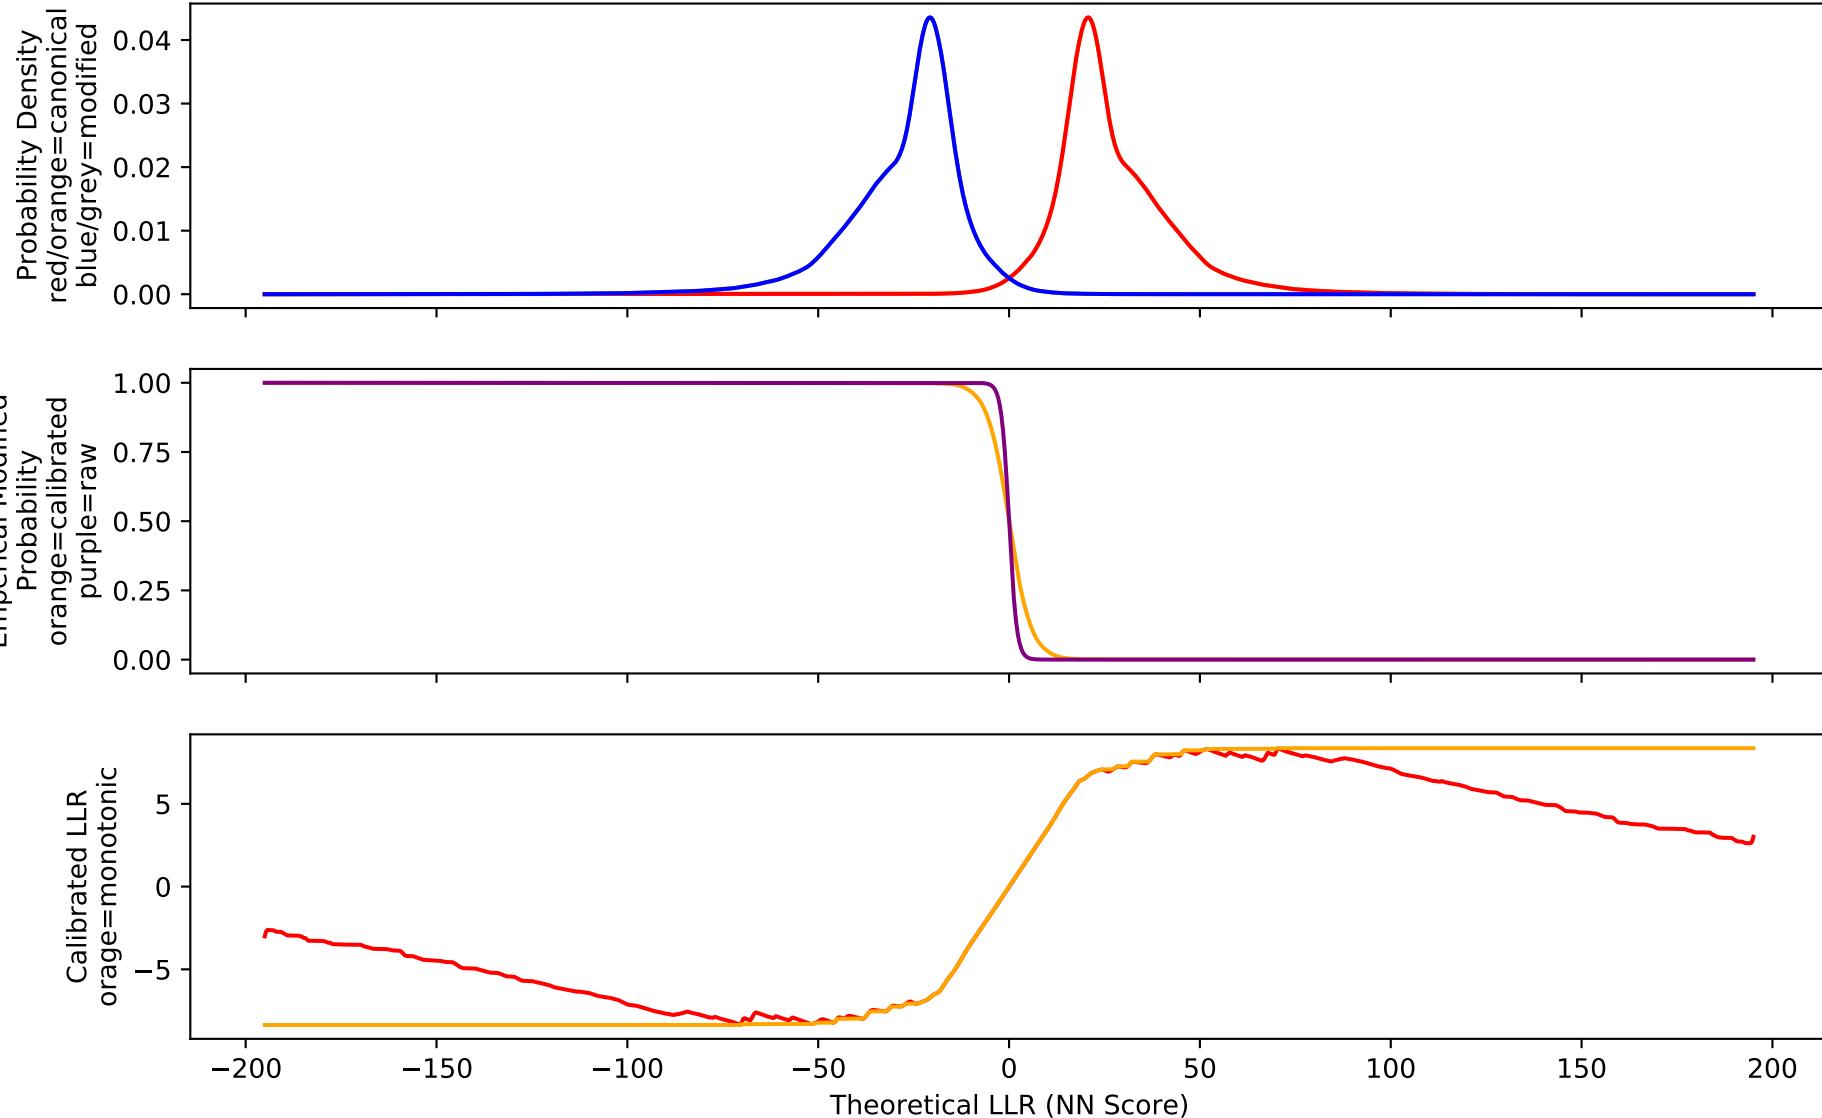


### SNP: T -> A Calibration

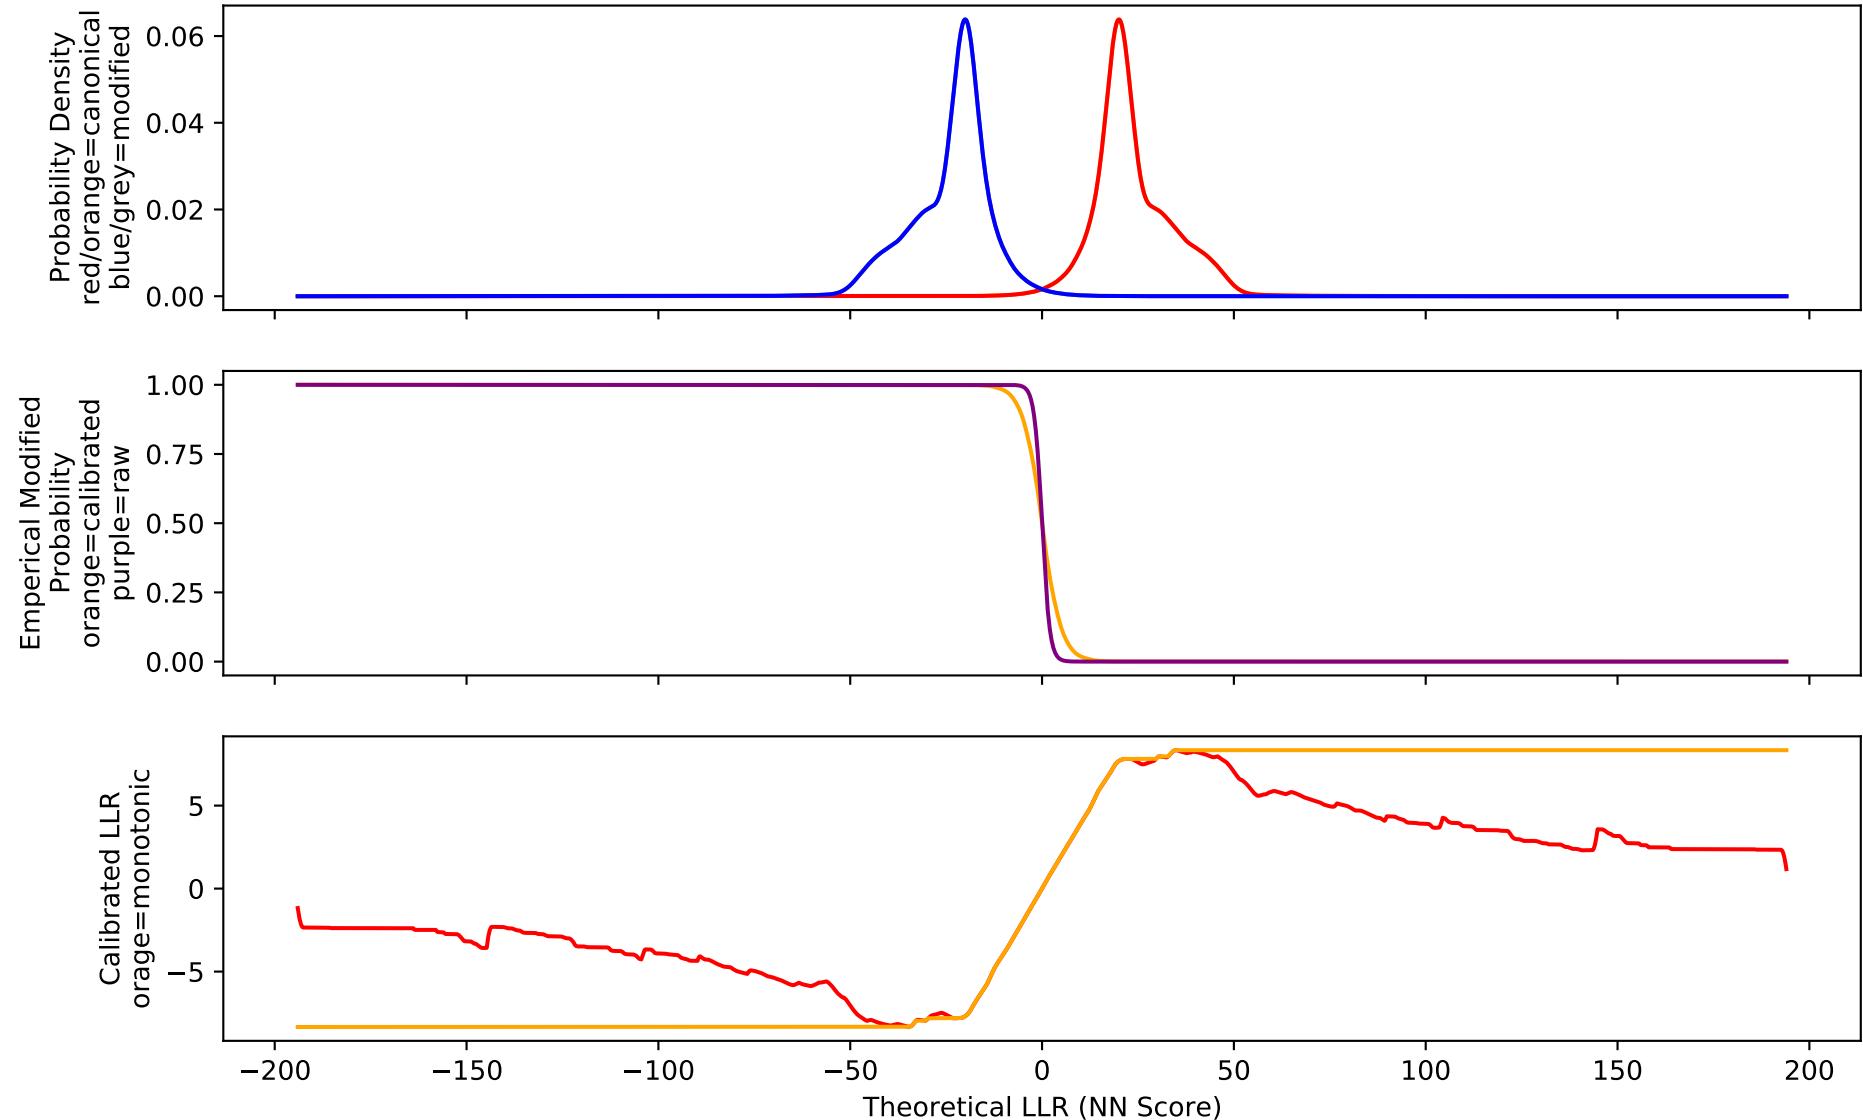


### SNP: T → C Calibration

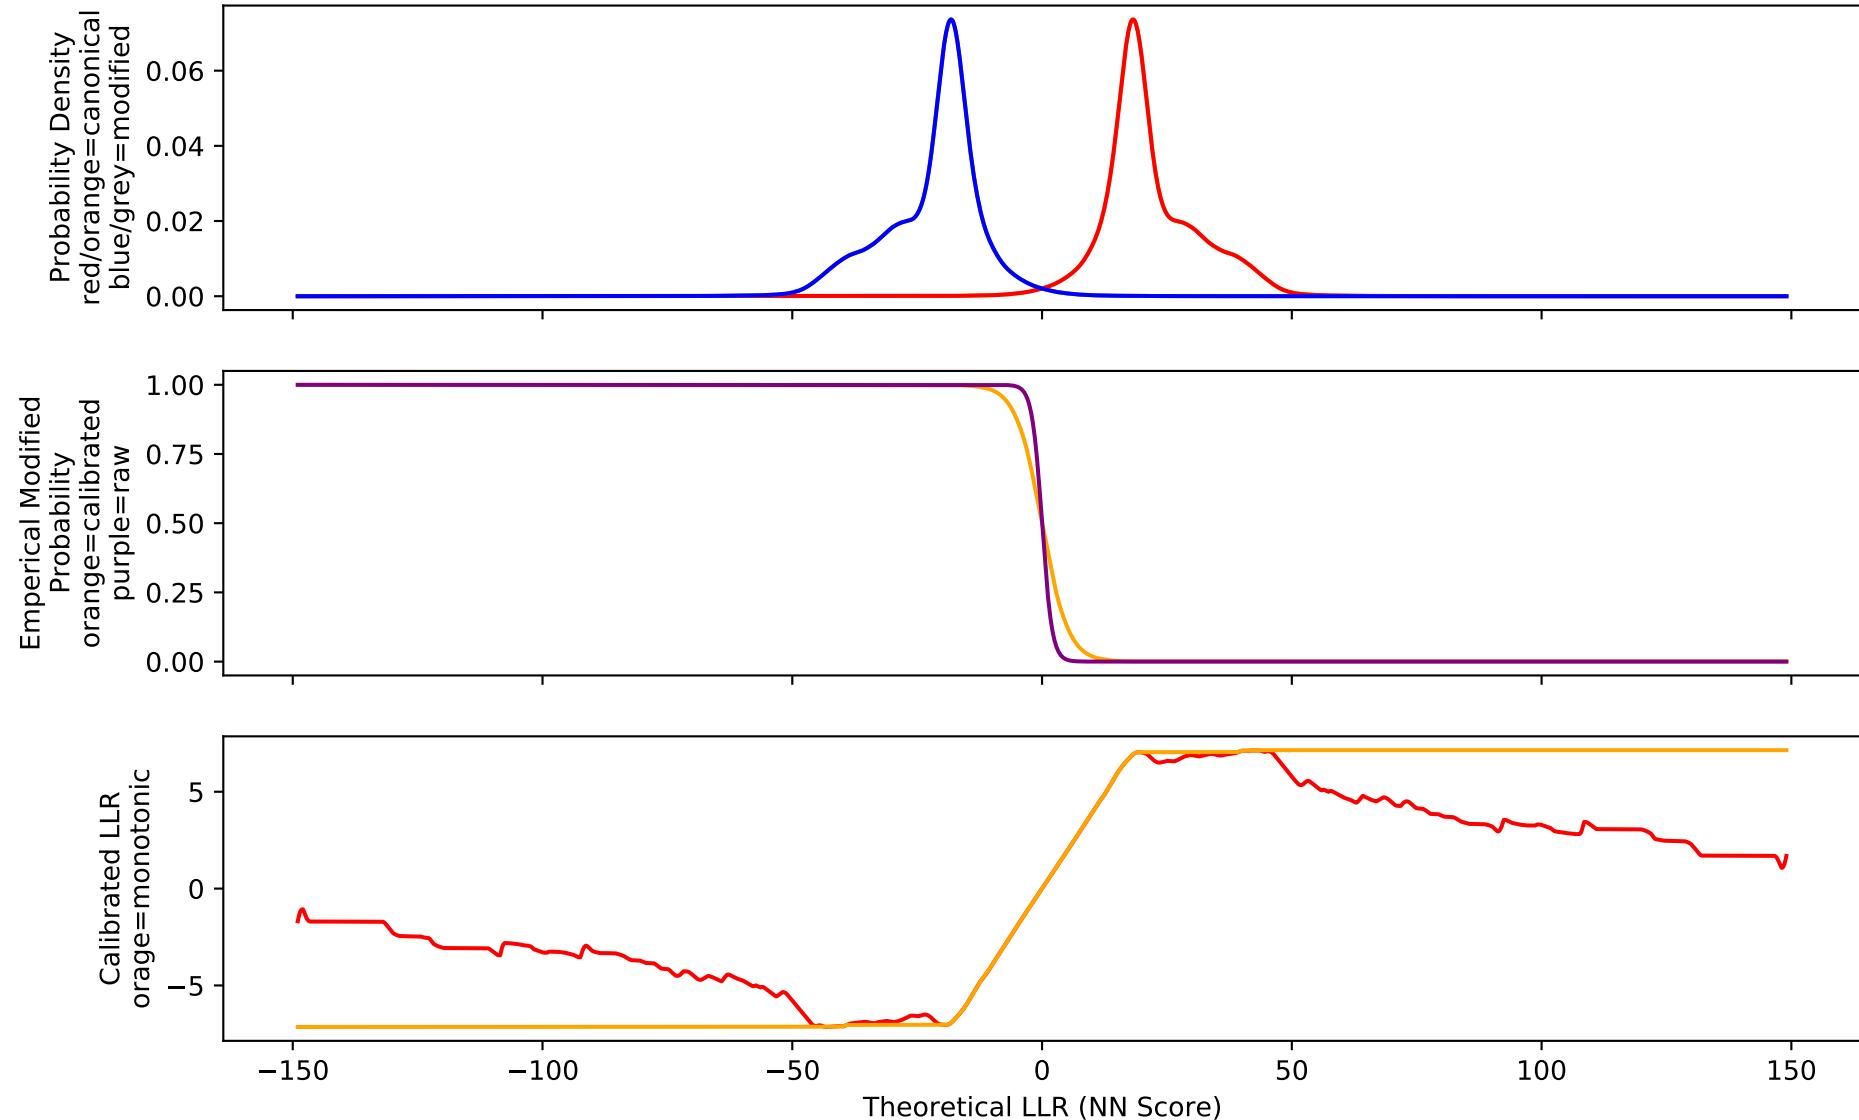


### SNP: T -> G Calibration

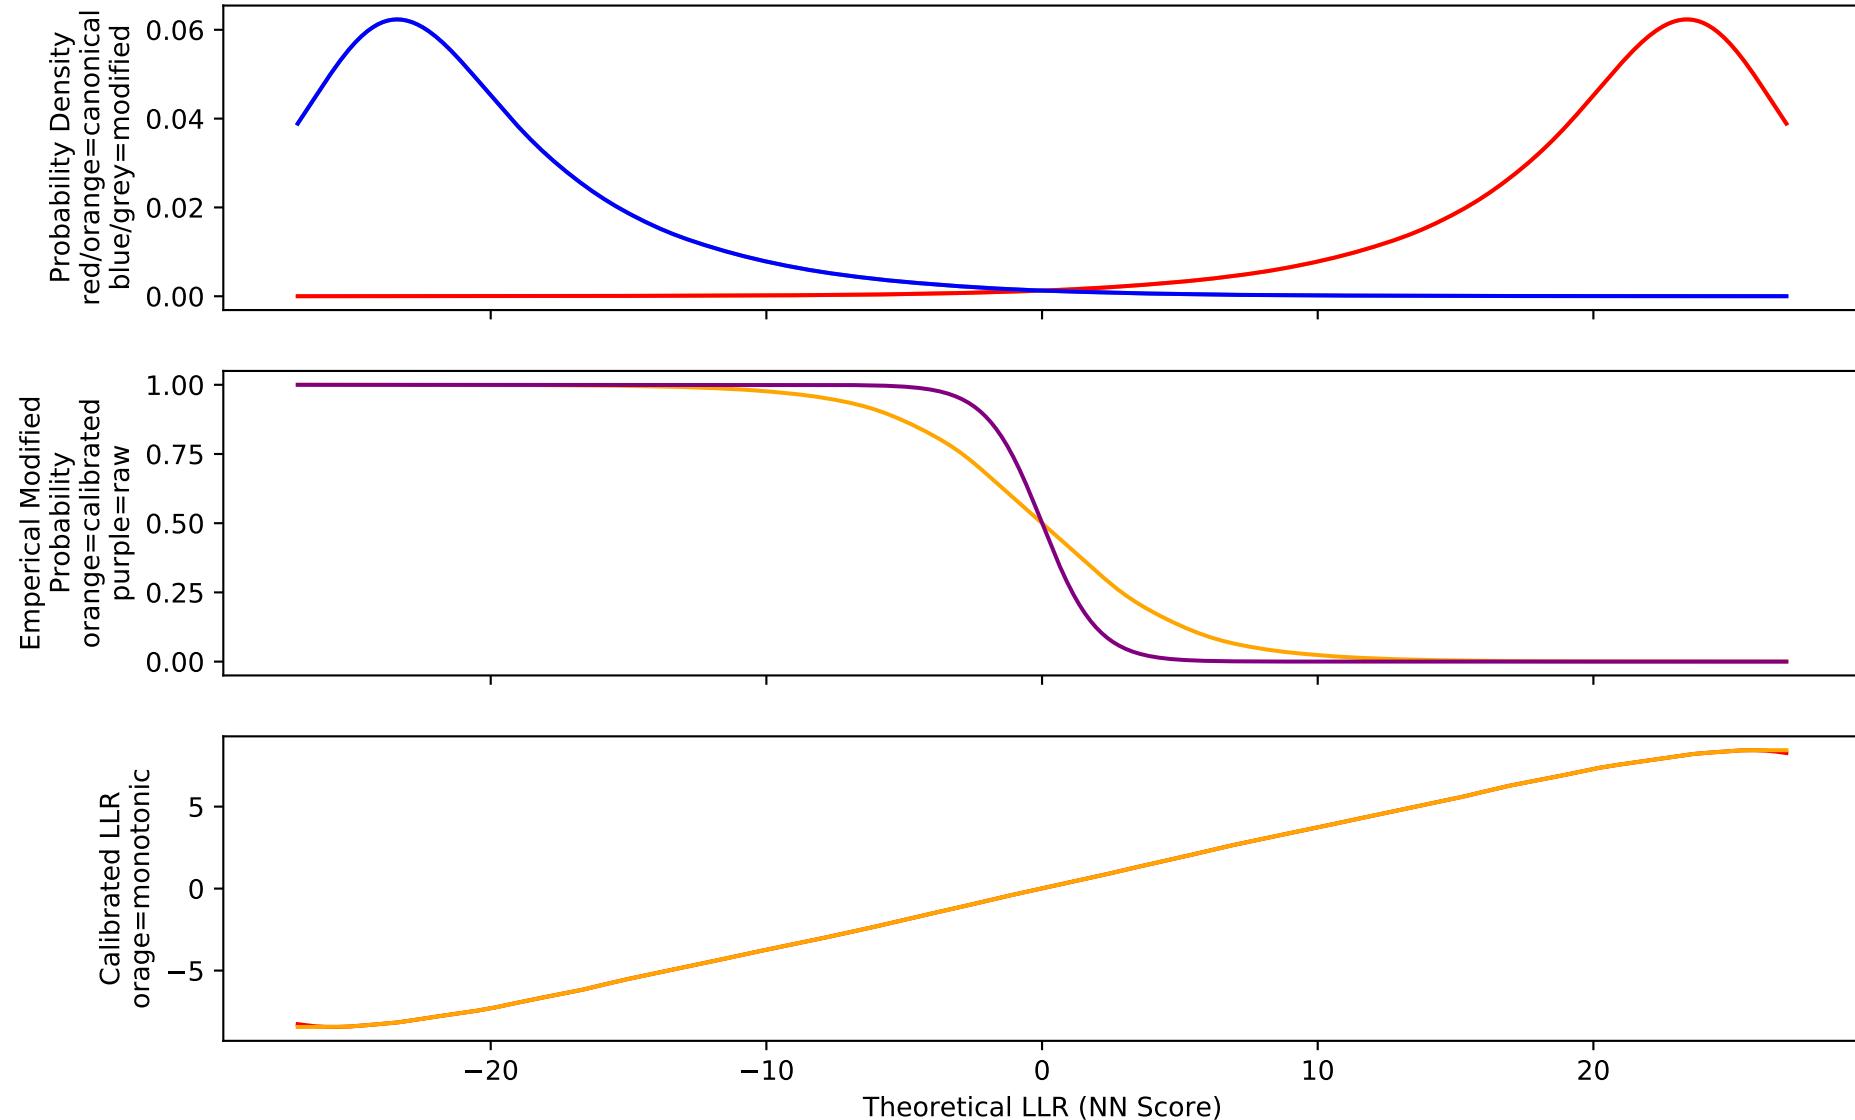


### Deletion Length 1 Calibration

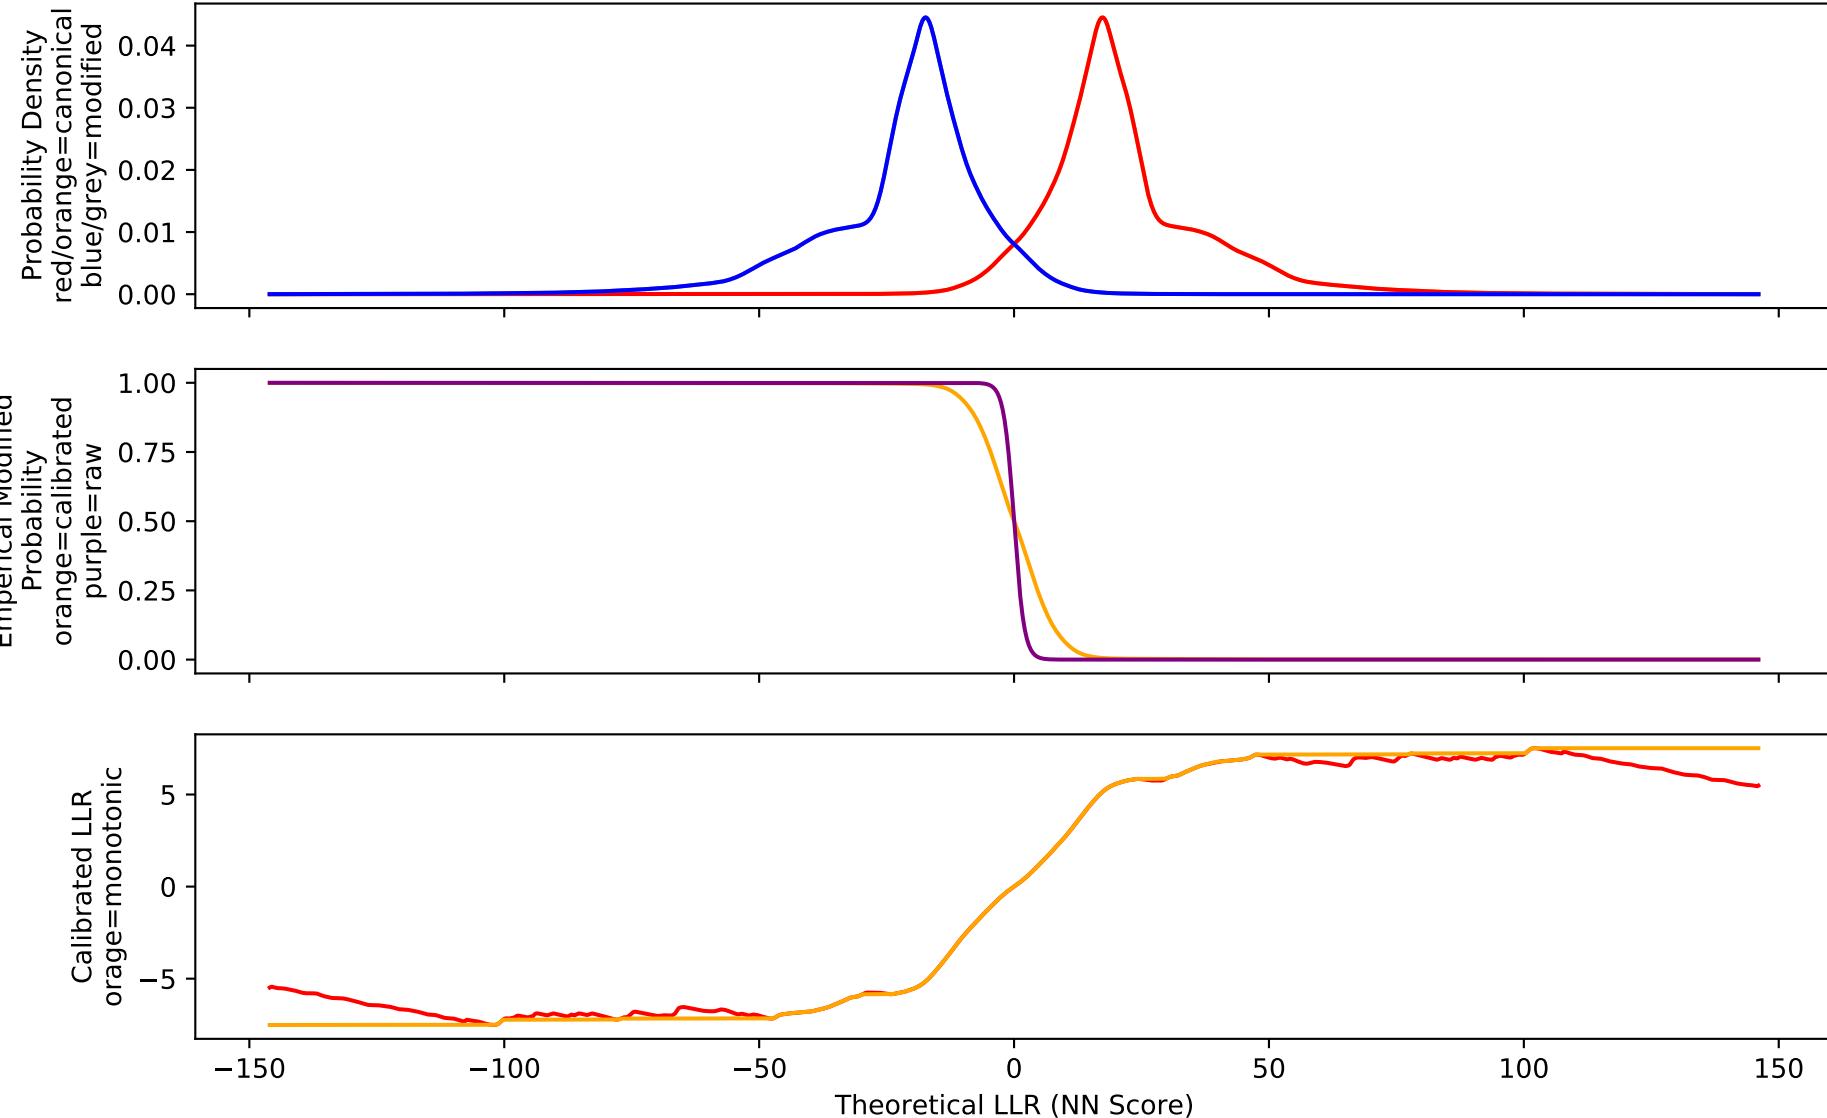


## Deletion Length 2 Calibration

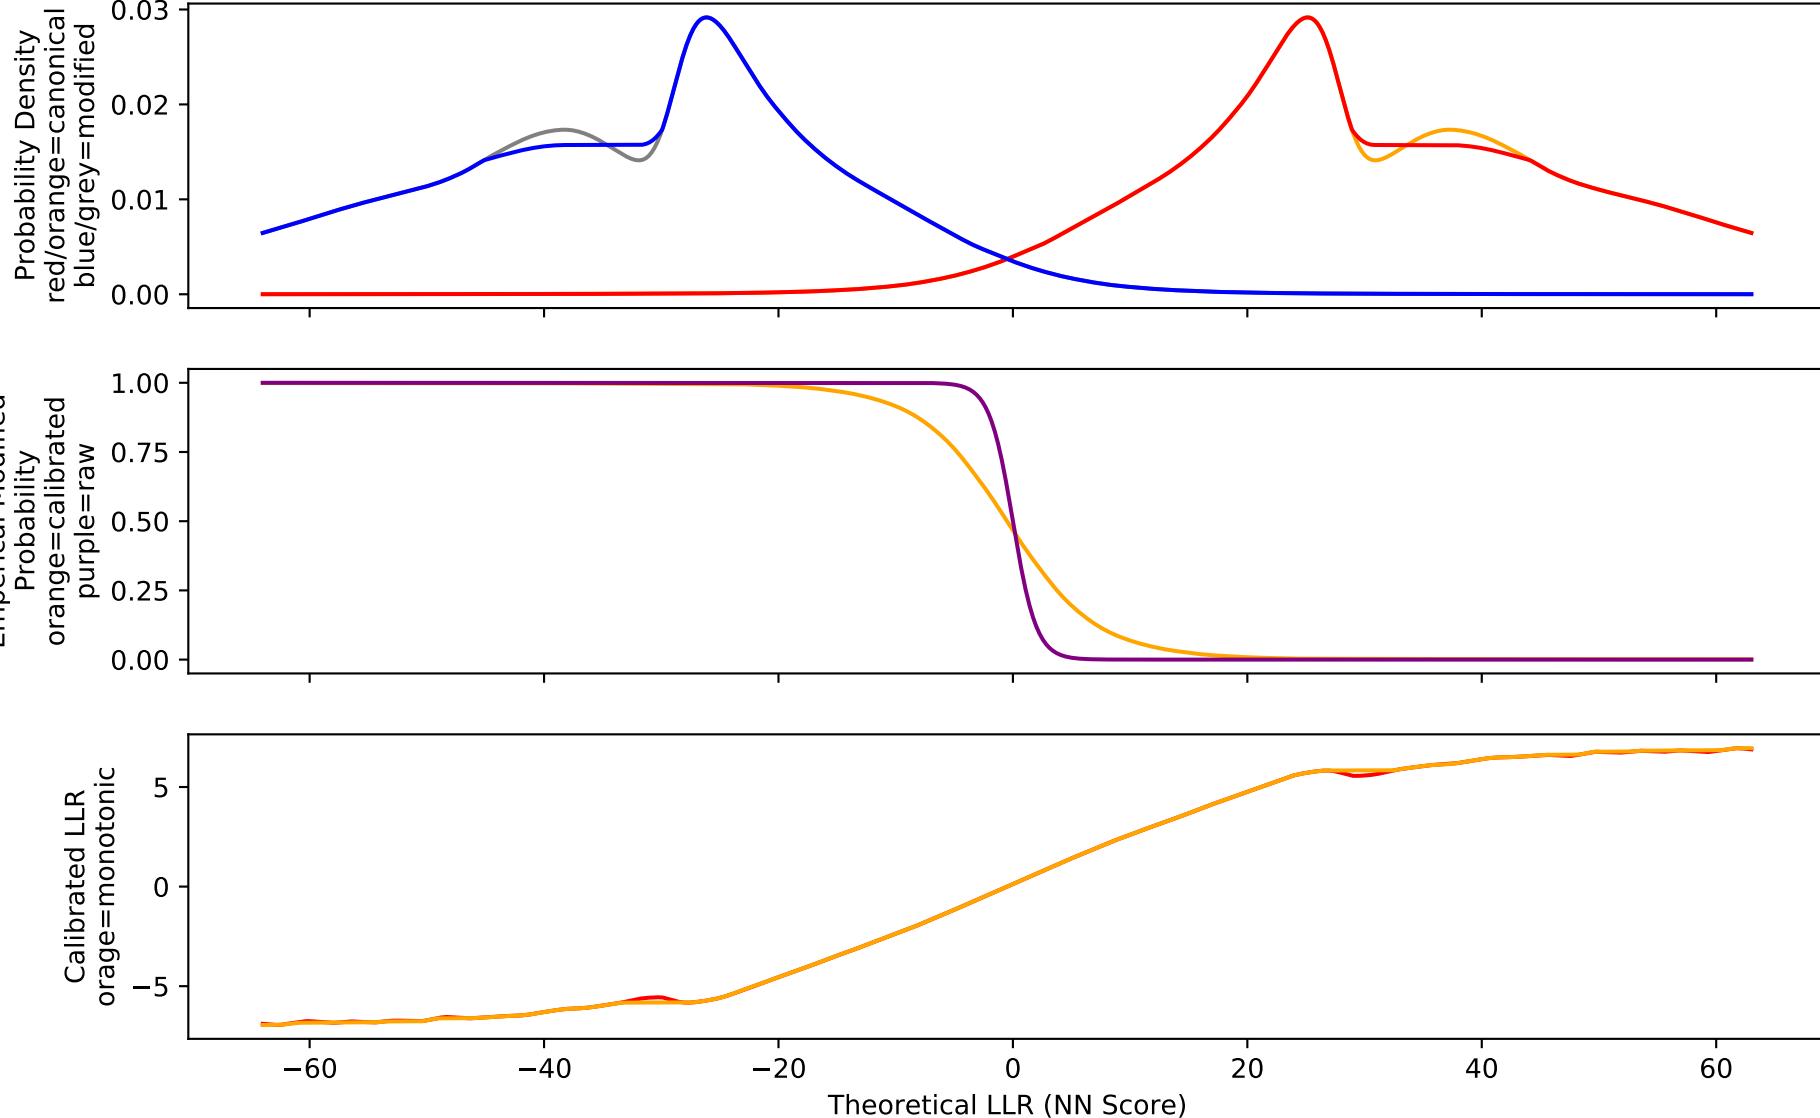


### Deletion Length 3 Calibration

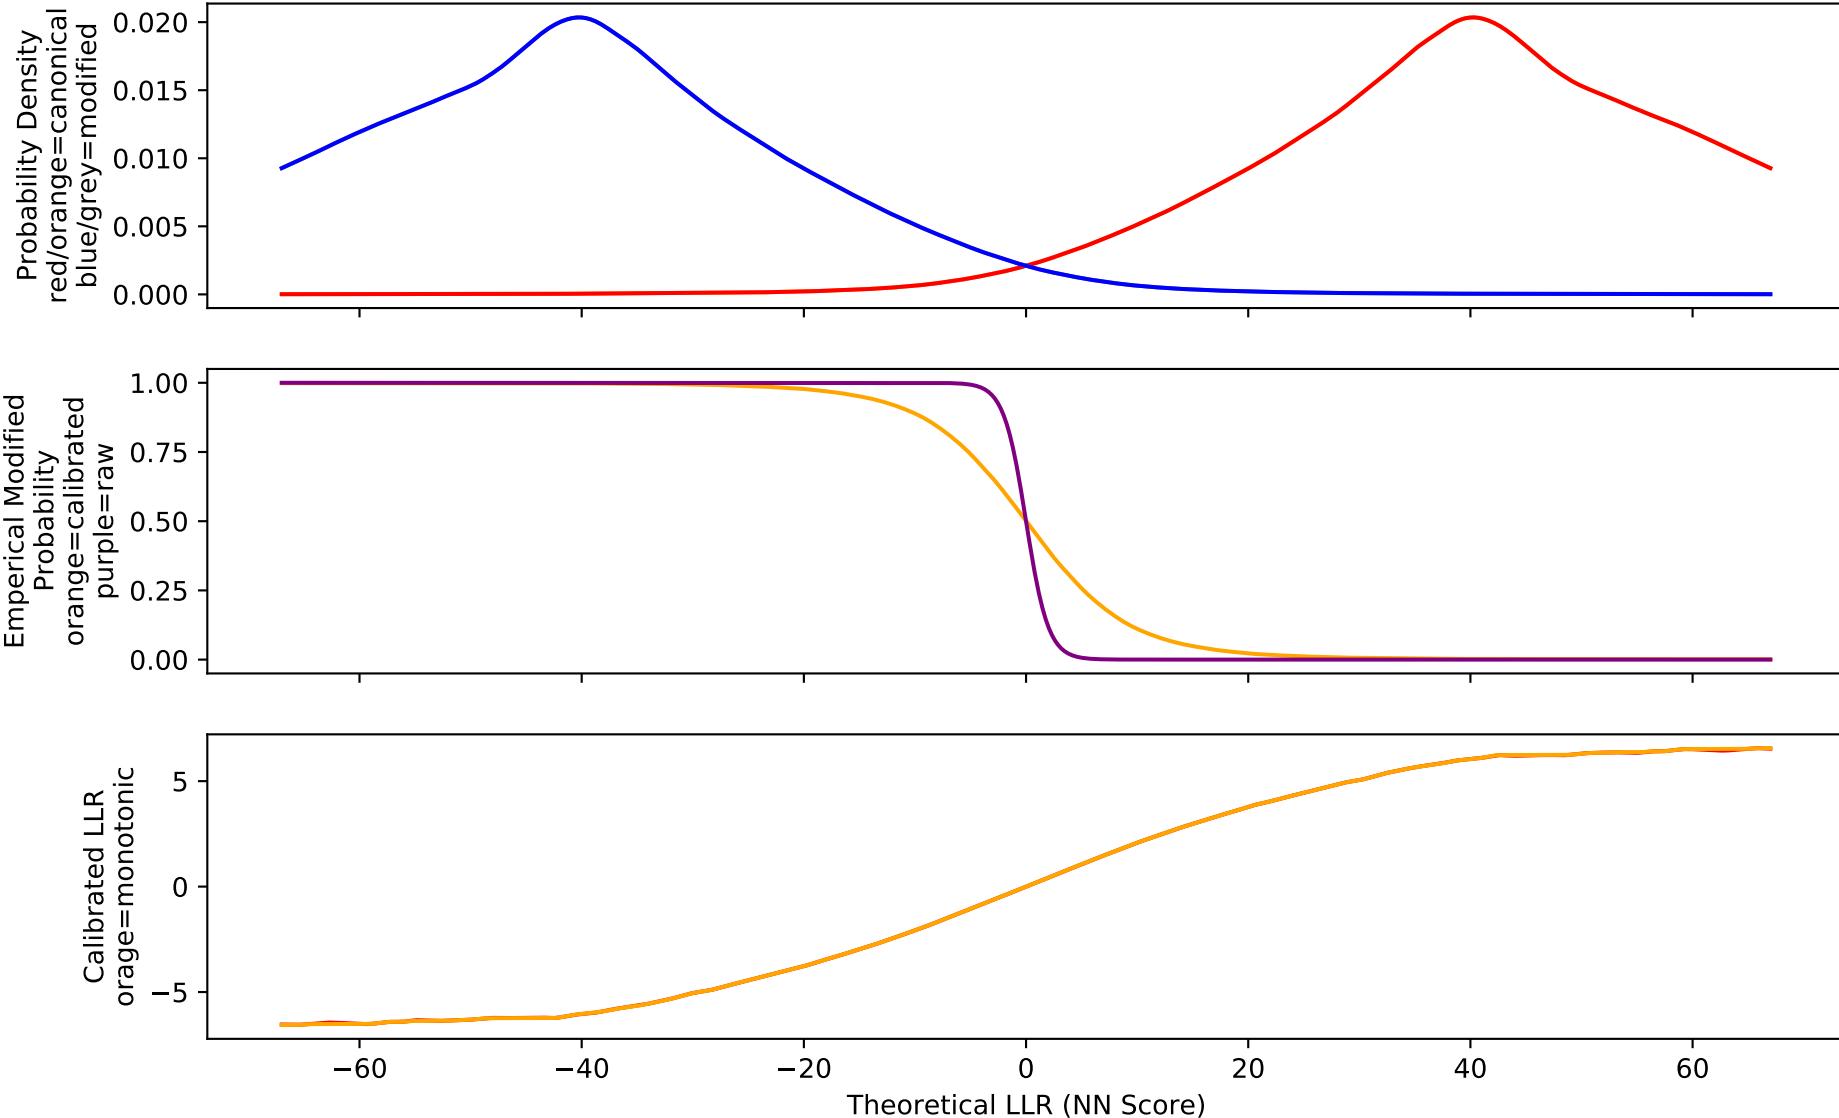


### Deletion Length 4 Calibration

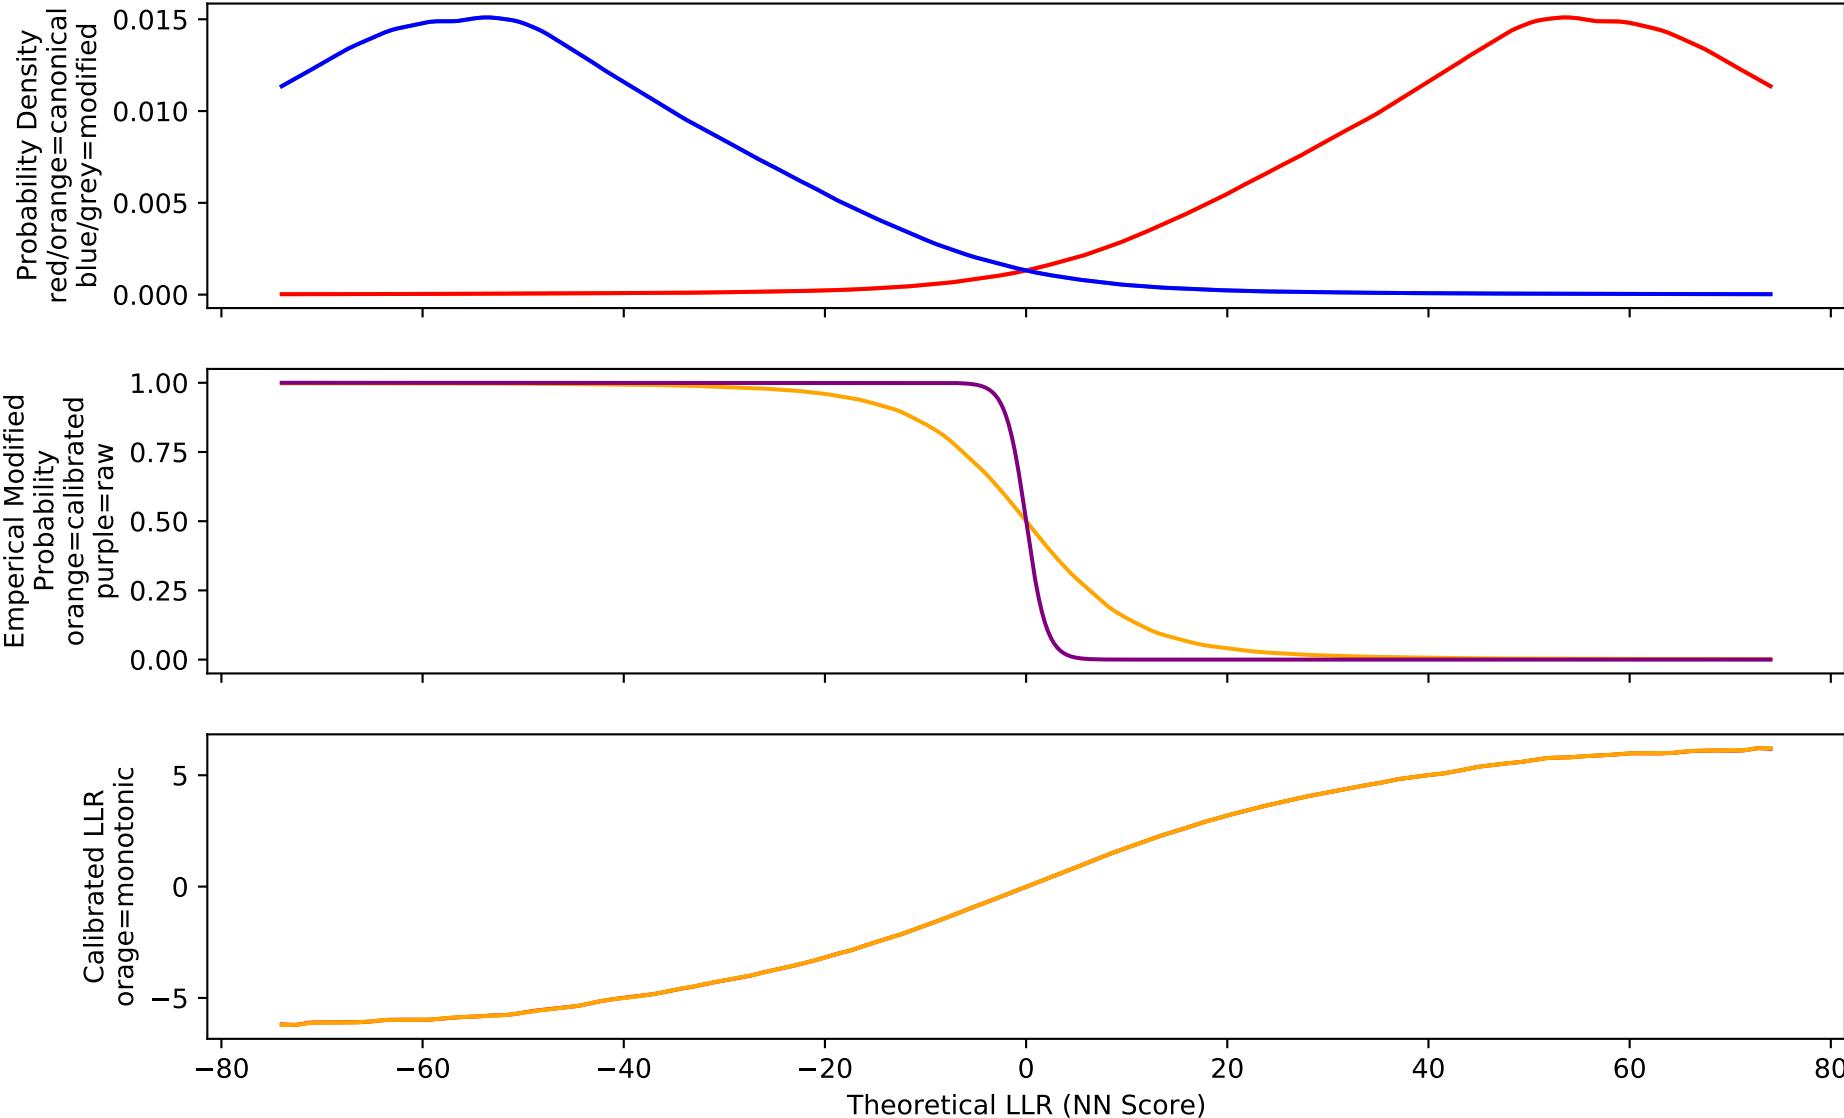


### Deletion Length 5 Calibration

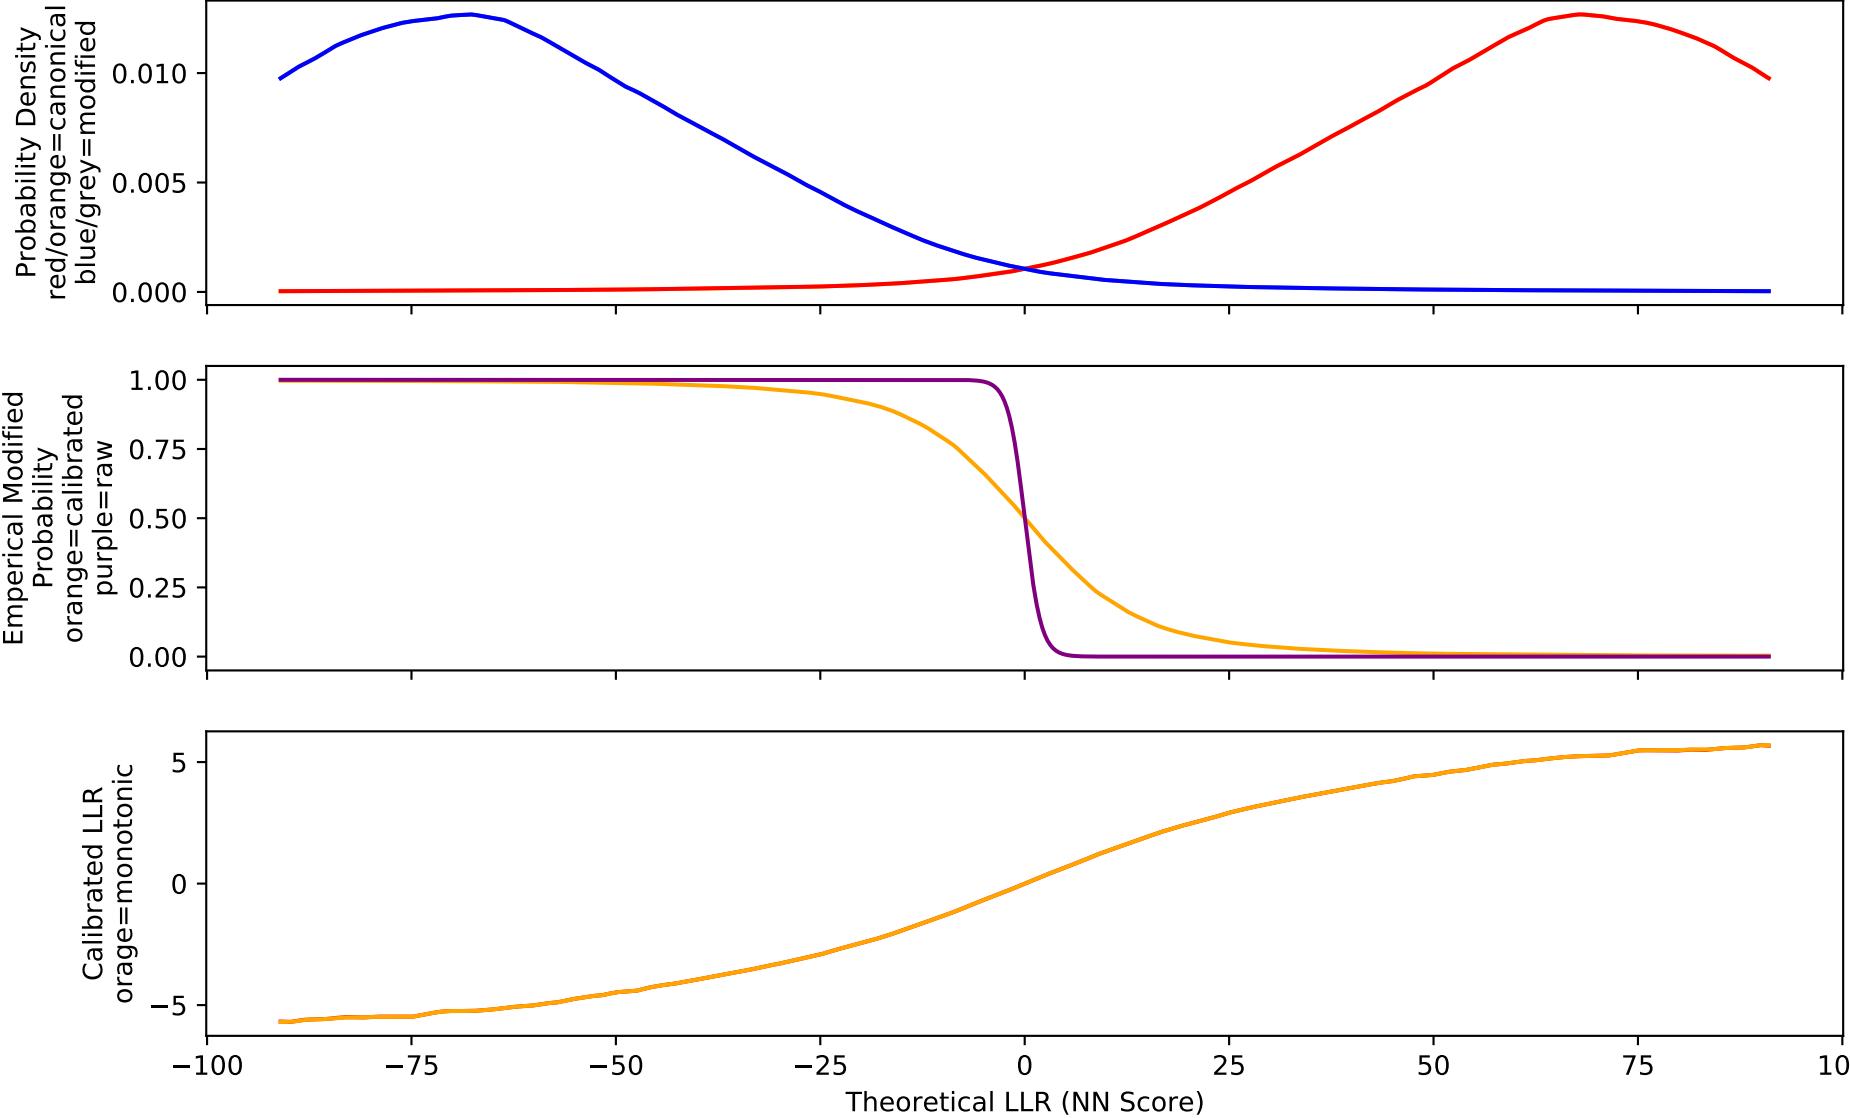


### Insertion Length 1 Calibration

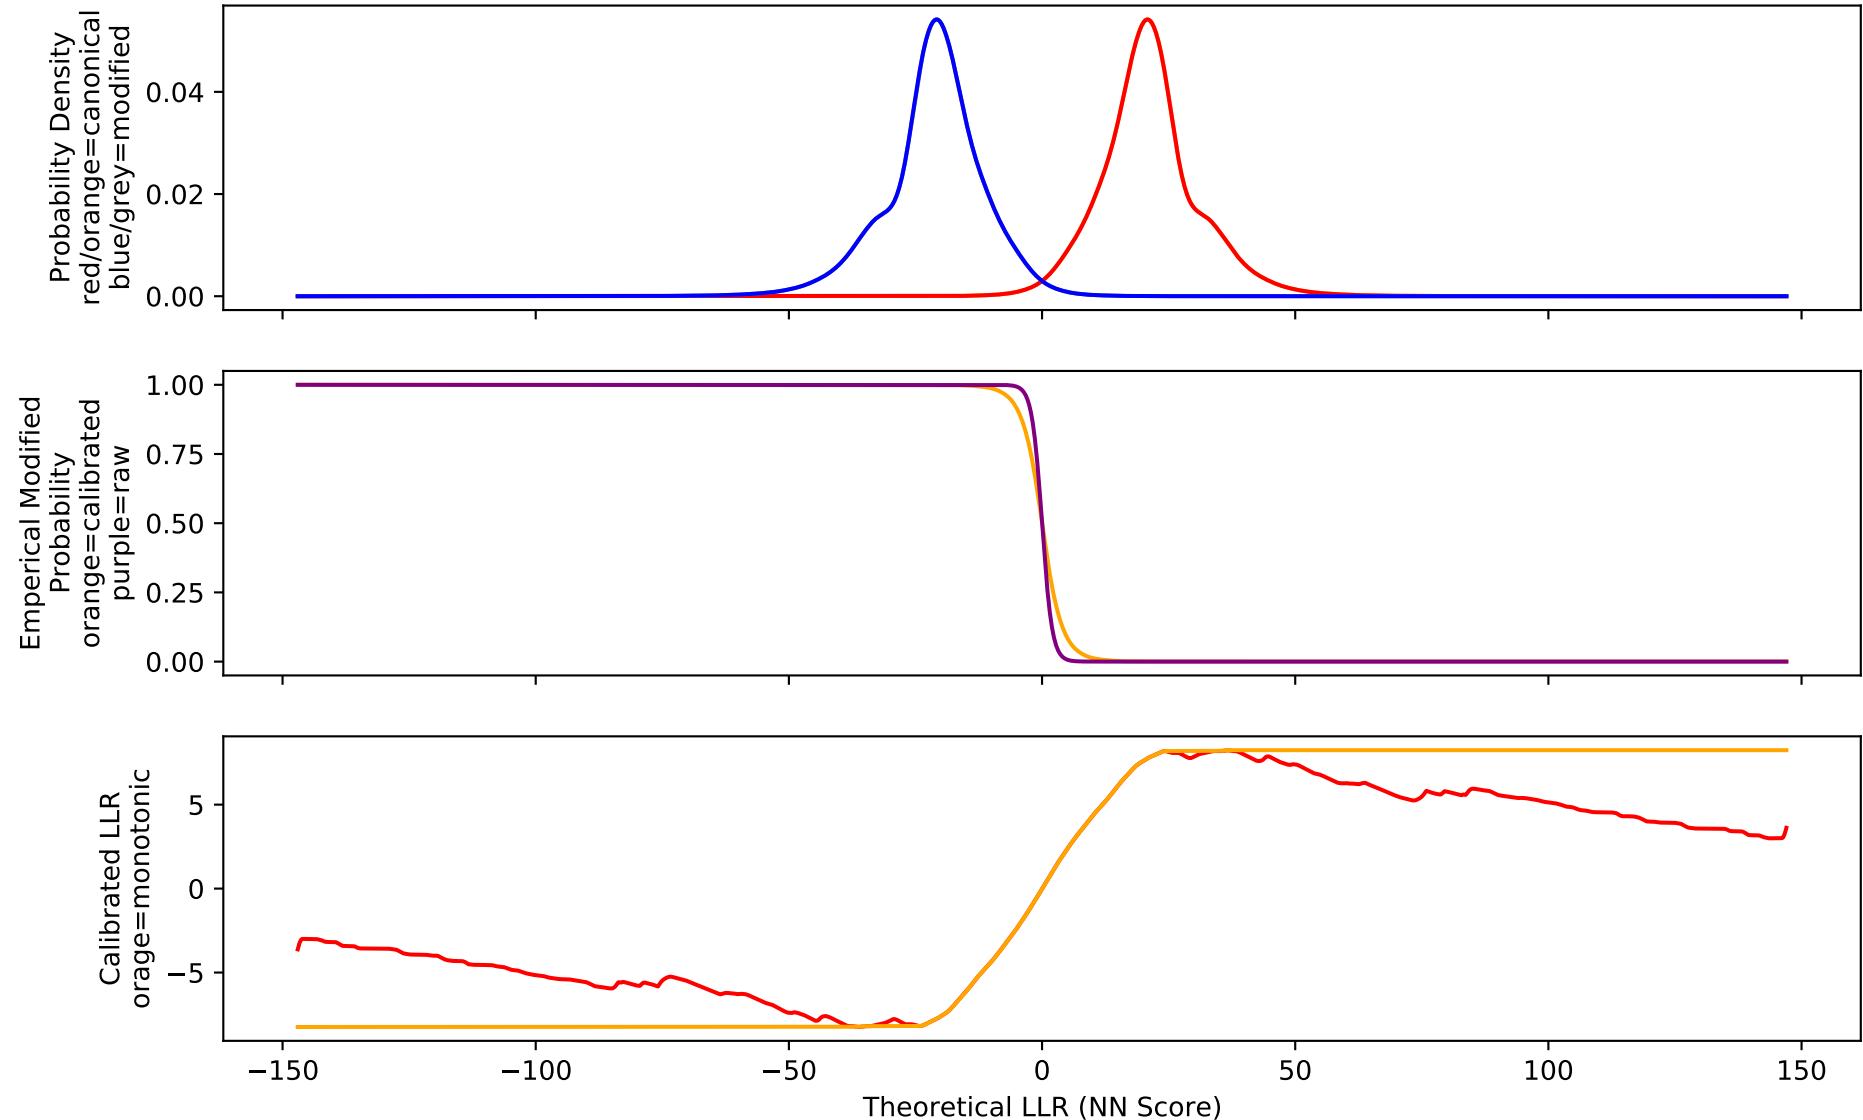


## Insertion Length 2 Calibration

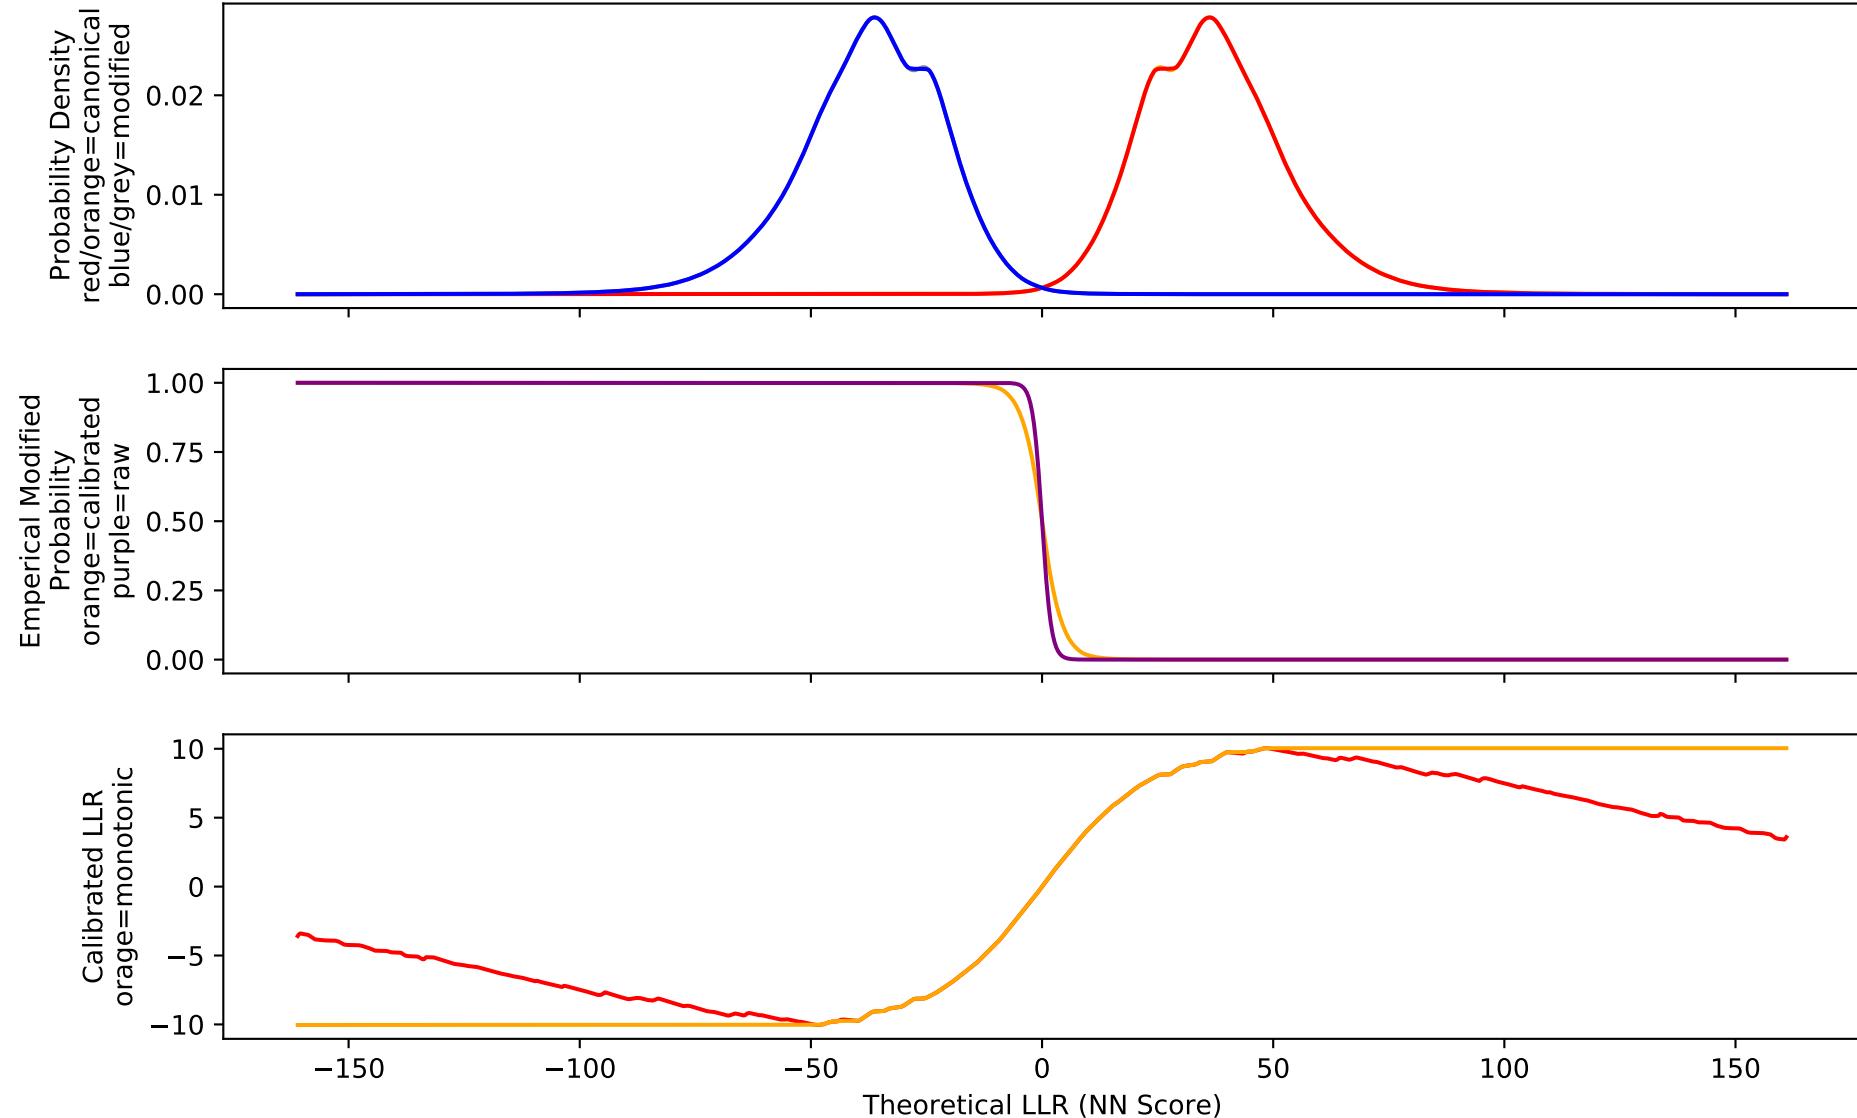

### Insertion Length 3 Calibration

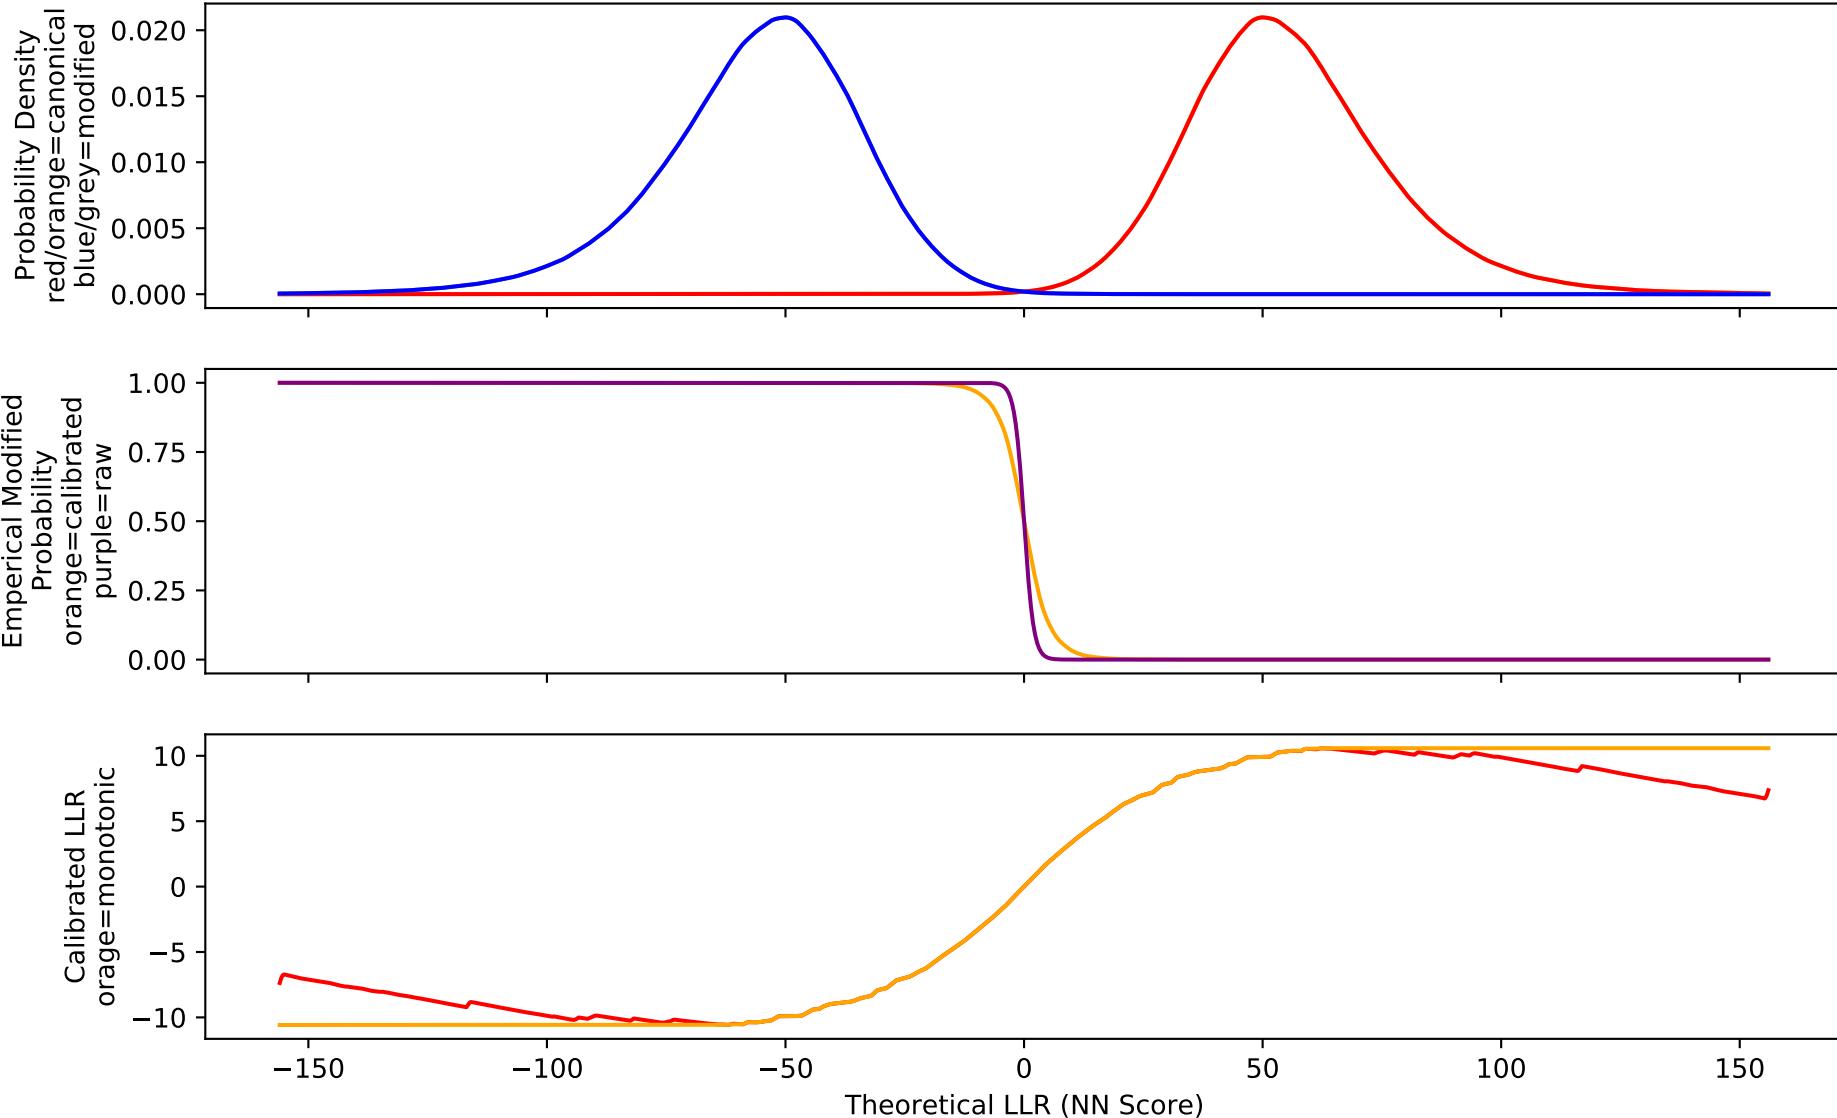

### Insertion Length 4 Calibration

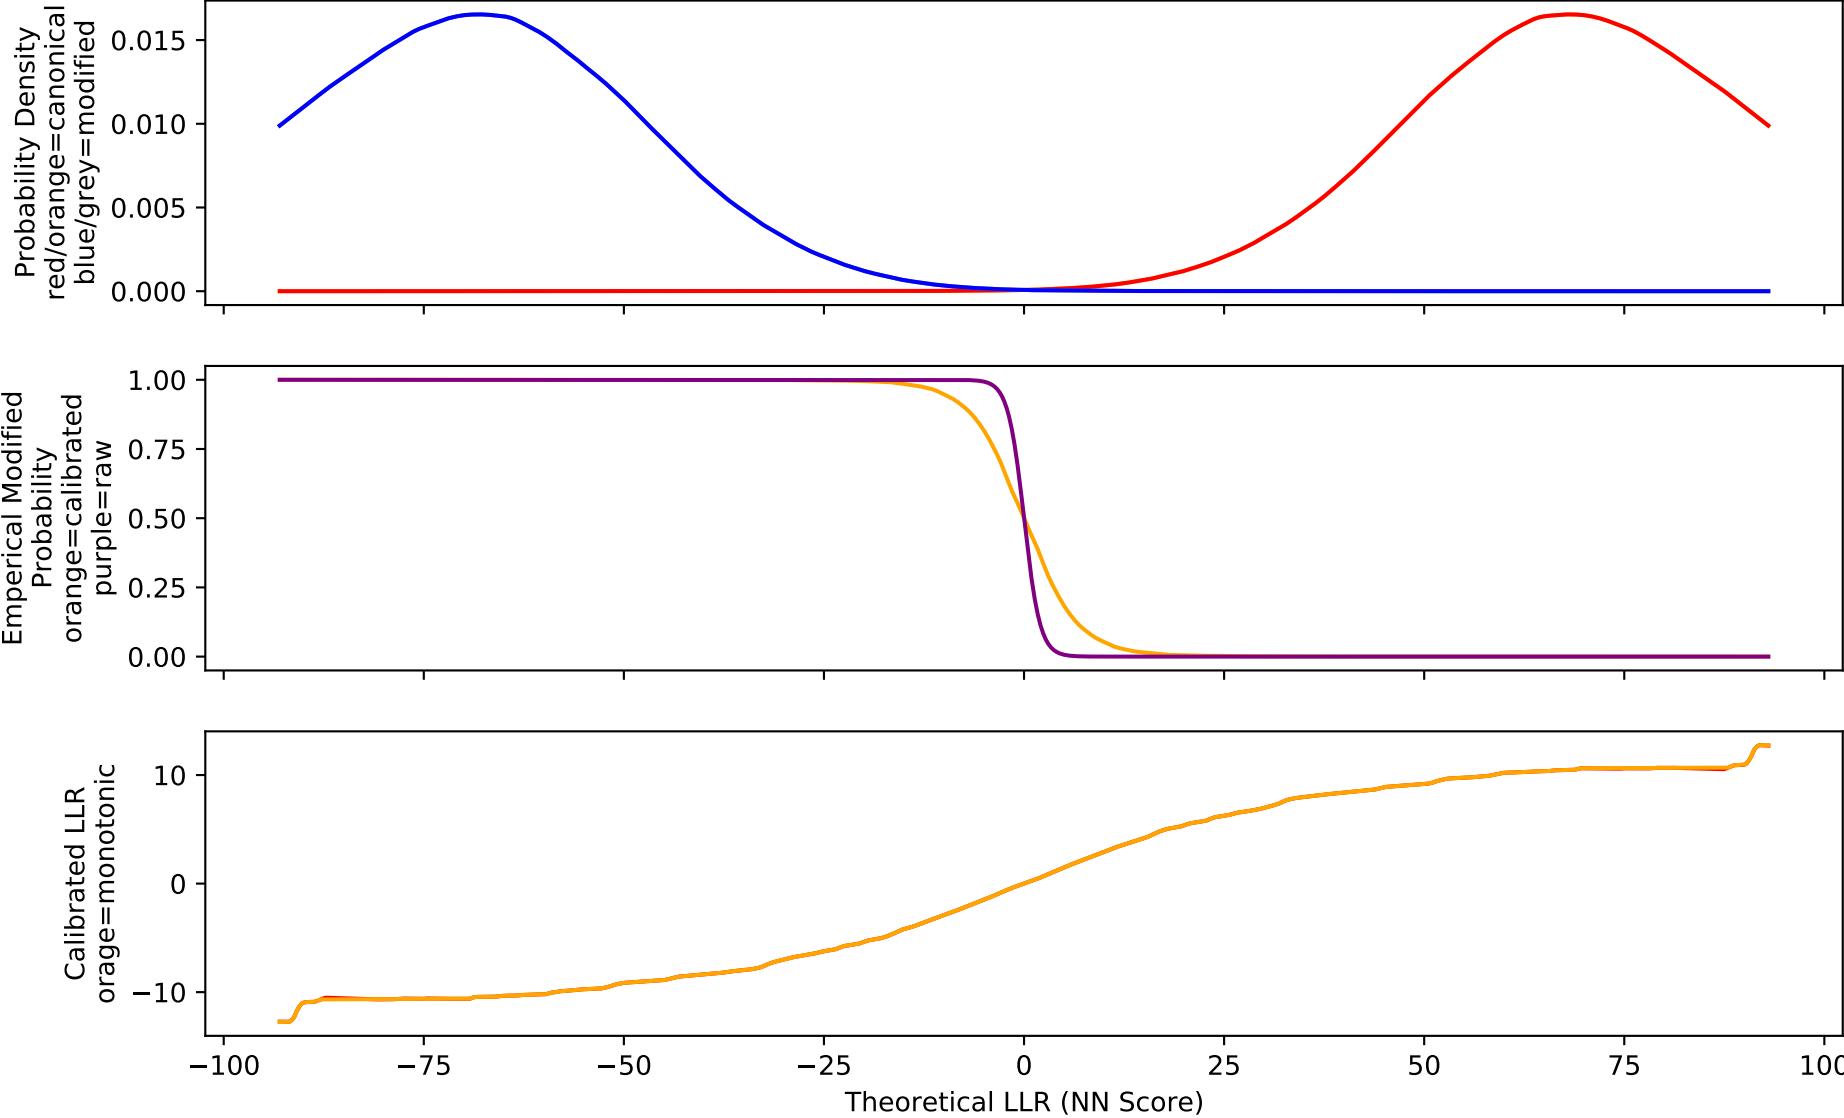

### Insertion Length 5 Calibration

